



# **Functionality Assessment of Household Tap Connection under National Jal Jeevan Mission - 2022**



**STATE REPORT: JAMMU AND KASHMIR  
SURVEY DURATION: MARCH TO APRIL 2022**

## Contents

Abbreviations .....	2
Glossary .....	3
Executive Summary .....	5
1. State Factsheet .....	8
2. Context .....	10
2.1. State snapshot: Jammu & Kashmir .....	10
2.2. FHTC Assessment Objectives .....	11
2.3. Assessment Methodology .....	11
2.4. Sample Size .....	11
2.5. Sampling Methodology .....	12
2.6. Methodology for Water Quantity Measurement at Households .....	13
2.7. Methodology for Water Quality Measurement .....	13
2.8. Project Implementation .....	15
2.9. Sample coverage .....	16
2.10. Sampled village and household profile .....	16
3. Findings .....	17
3.1. Functionality status of FHTC at household level .....	17
3.2. Quantity, Regularity, and Quality of Water .....	20
3.3. Operation and Maintenance (O&M) of schemes at village level .....	28
3.4. Utilization of water at HHs for drinking and other activities .....	30
3.5. Source sustainability at the village level .....	34
3.6. Water quality monitoring and surveillance in the villages .....	35
3.7. Management of water service delivery at village level .....	38
3.8. Status of Operation & Maintenance .....	39
3.9. Status of service delivery related grievances and redressal .....	42
3.10. Perception of HHs on Outcome Indicators .....	45
3.11. User satisfaction .....	47
4. Functionality status of FHTC at household level for Har Ghar Jal districts .....	48
4.1. Overall Functionality (in %) .....	48
4.2. Perception of HHs from Har Ghar Jal districts on Outcome Indicators .....	49
4.3. Direct benefits in terms of income due to FHTC .....	50
4.4. Change in social status .....	50
5. Functionality status of FHTC at household level for aspirational districts .....	51
5.1. Overall Functionality (in %) .....	51
5.2. Perception of HHs from aspirational districts on Outcome Indicators .....	52
5.3. Direct benefits in terms of income due to FHTC .....	52
5.4. Change in social status .....	53
6. Annexure .....	54

## Abbreviations

AWC	Aanganwadi Centre
FHTC	Functional Household Tap Connection
Gol	Government of India
GP	Gram Panchayat
HF	Health Facility
HH	Household
HGJ	Har Ghar Jal
JJM	Jal Jeevan Mission
LPCD	Litres per Capita per Day
MVS	Multi-village Scheme
NJJM	National Jal Jeevan Mission
RC	Residual Chlorine
O&M	Operation and Maintenance
OHT	Over Head Tank
PSU	Primary Sampling Unit
PWS	Piped Water Supply
SVS	Single Village Scheme
VAP	Village Action Plan
VWSC	Village Water and Sanitation Committee
WQMIS	Water Quality Monitoring and Information System

## Glossary

1. **Community** – Group of people living in one particular area or village/habitation
2. **Cross-sectional research** – A cross-sectional study is a type of research design in which data is collected from a relatively large and diverse group of people at a single point in time
3. **Drinking water source** – Groundwater (open well, borewell, tube well, handpump, spring, etc.)/ surface water (river, lake, pond, reservoir, etc.)/rainwater, available for drinking and domestic use
4. **Improved sources** – The following sources as considered improved by the National Family Health Survey definitions: Piped water into dwelling, yard/plot with a tap, piped water connected to public stand-posts, tube well or borewell, Hand pump, dug well–protected, Spring–protected, Rainwater, Water ATM/ Community RO plant/ Community Water Purification Plant (CWPP)
5. **Unimproved sources** – The following sources as considered unimproved by the National Family Health Survey definitions: Unprotected spring, unprotected dug well, cart with small tank / drum, Tanker/ truck, Surface water (river/ dam/ lake/ pond/ canal), and bottled water
6. **Functional Household Tap Connection (FHTC)** – A tap connection to a rural household for providing drinking water in adequate quantity of prescribed quality on regular basis.
7. **Functionality of FHTC** – Functionality of a tap connection is defined as having infrastructure, i.e., household tap connection providing water in adequate quantity, as presented:

Definitions	Fully-functional	Partially-functional	Non-functional
Quantity	$\geq 55$ LPCD	$> 40$ lpcd - $< 55$ LPCD	$< 40$ LPCD
Regularity	12 months or daily basis	9-12 months or $<$ daily basis	$< 9$ months or $<$ daily basis
Quality	Potable	Potable	Non potable

8. **Quantity (in litres)** of water received by households per person per day should meet the service level of 55 lpcd.
9. **Functionality Assessment** – An assessment of the functionality of rural household tap connections based on a sample survey
10. **Fully Regular** – Regularity of water is considered when a rural household receives water for 12 months on daily basis or as per schedule.
11. **Potability** – Potable water is water that is safe to be used as drinking water. Parameters of potable water are mentioned below:

Parameters for potable water tested in the survey	Unit	Acceptable Limit	Permissible Limit in the absence of alternative sources
i. pH (tested on site)	-	6.5 to 8.5	No relaxation
ii. Free residual chlorine (tested on site)	Mg/litre	0.2	1
iii. Turbidity	NTU	1	5
iv. Total hardness	Mg/litre	200	600
v. Total alkalinity	Mg/litre	200	600
vi. Chloride	Mg/litre	250	1000
vii. Ammonia	Mg/litre	0.5	No relaxation
viii. Phosphate	Mg/litre	0.3	1
ix. Iron (in hotspots only)	Mg/litre	1	No relaxation
x. Nitrate	Mg/litre	45	No relaxation
xi. Sulphate	Mg/litre	200	400

xii.	Total dissolved solids	Mg/litre	500	2000
xiii.	Fluoride	Mg/litre	1	1.5
xiv.	Arsenic (in hotspots only)	Mg/litre	0.01	No relaxation
xv.	Bacteriological test for Total coliform bacteria and E. coli or thermotolerant coliform bacteria		Shall not be detectable in any 100 ml sample	

12. **Sampling** – Selection of a subset of individuals from within a statistical population to estimate water service delivery among the population. In the current study, households have been sampled to estimate the representation of the village and subsequently of the district as well as of the state.
13. **Types of schemes:** Following are the piped water supply schemes that were assessed
- Mini-solar based piped water supply scheme in isolated/tribal hamlets
  - Single Village Scheme (SVS) in villages having adequate groundwater that needs treatment
  - Single village scheme (having adequate groundwater/ spring water/ local or surface water source of prescribed Quality)
  - Retrofitting of ongoing schemes taken up under erstwhile NRDWP for the last mile connectivity/ retrofitting of completed rural water supply schemes to make it JJM compliant
  - Multi-village PWS scheme - with water grids/ regional water supply schemes
14. **Village Action Plan (VAP)** – Plan prepared by Gram Panchayat and/ or its sub-committee, i.e., VWSC/ Paani Samiti/ User Group, etc. based on baseline survey, resource mapping and felt needs of the village community to provide FHTC to every rural household, treat the generated greywater and plan its reuse, undertake surveillance activities, etc. VAP also indicates the fund requirement and timelines for completion of work under the Mission and will be approved by the Gram Sabha. Irrespective of the source of funding, all drinking water-related works in the village are taken up based on the VAP.
15. **Source Sustainability** – includes measures such as aquifer recharge, rainwater harvesting, increased storage capacity of water bodies, reservoirs, de-silting, etc. improve the lifespan of water supply systems
16. **Har Ghar Jal (HGJ)** – An administrative unit wherein all HHs are provided with water supply through FHTCs is called “Har Ghar Jal”.
17. **Public Institutions** – The public institutions in the survey include Aanganwadi Centre (AWC), Health Facilities, Schools, Gram Panchayat, and government buildings.
18. **Working tap connection** – A tap connection supplied water at least one day in the week, preceding of survey
19. **Functional Scheme** – A scheme is said to be functional if it was reported to be working for all 12 months in a year.

Note: The detailed analysis of data at the district level has been incorporated in the District Reports presented separately. The State Reports are to be read in concurrence to the District Reports.

## Executive Summary

Jal Jeevan Mission (JJM) was launched on the 15th of August 2019 with the objective to provide functional household tap connections (FHTCs) to all rural households. NJJM, GoI engaged HTA Kantar Public to conduct the 'Functionality Assessment' of the tap connection at households as well as public institutions/ buildings such as schools, anganwadis, gram panchayat buildings, public health facilities, and wellness centers in all the rural districts for the financial year 2021-22.

A cross-section research design has been used for this functionality assessment study. The sample size was calculated to provide estimates with a 95% confidence interval (CI) and 5% margin of error (MoE) after incorporating the correction factor for a finite population considering the total number of geographic units having FHTCs. As per the design, all villages having a piped water scheme (PWS) with 20 or more functional household tap connections were included in the sample frame. A statistically significant number of villages were randomly selected in each of the districts.

Additionally, the flow rate of the water supply was measured for head, mid, and tail end households of the selected PWS. Water quality was tested for all public institutions available in the villages, including schools, anganwadis, gram panchayat buildings, public health facilities, and wellness centers, and at the selected households. Two types of quality tests were carried out – a) spot test for pH and free residual chlorine, and b) water sample was collected and transported to labs for testing against 13 quality parameters.

The state of Jammu & Kashmir lies in the northern part of India and has a population of 1,22,67,013 people (Census 2011). It has 20 districts and 6,887 villages, and 6,486 villages have PWS schemes. The state is yet to achieve the Har Ghar Jal status. A total of 365 villages, across all districts, and 7780 households were randomly sampled for the survey, and additionally, water samples from 674 public institutions were tested.

In the assessment among sampled villages, 77% of villages have only one scheme, 18% of villages have 2-3 schemes, and 4% of villages have 4 and more schemes. Mostly all schemes across the state were found functional.

At the state level, 80% of the HHs were satisfied with the regularity of the supply, 82% with the quality of the water supplied, 84% with the colour of the water supplied, and 84% with the taste of the supplied tap water.

### Overall functionality status of Jammu and Kashmir

At the state level, 97% of HHs received water on the day of the survey. While 53% of the HHs were found to have fully functional tap water connections within the premises. Out of which 84% received an adequate quantity of water, 70% reported receiving a fully regular supply of water, and 86% HHs received potable water.

It was found that more than 81% of households received water all 7 days a week and 8% received at least 3 to 4 days, while 6% of the HHs received water once a week. The average duration of water supply across the state was reported to be 2 hours per day.

In Jammu and Kashmir, 42% of the villages have reported that water is directly supplied to the households and the remaining 58% reported that water was supplied via an overhead tank, sump, or both.

During the roll-out of the data collection in the state, all-district level NABL accredited laboratories (labs) extended their support in accepting and testing water samples from HHs and public institutions. One of the challenges identified by the labs was the capacity to test more than 30-40 samples within 24 hours given the shortage of technicians and availability of necessary reagents in the required quantity. In Jammu and Kashmir, 8254 samples of water



were submitted, and 5854 were tested at the labs. The turnaround time of testing of water sample was more than 48 hours in most cases. Given this feedback, it can be conferred that these labs have limited scope to take up samples from the general public at large on a regular basis. The different quality parameters of the collected water samples that were tested were turbidity, total hardness, total alkalinity, chloride, iron, nitrate, sulphate, total dissolved solids, bacteriological test, arsenic, and fluoride.

Residual chlorine was found within the permissible limit only in 14% of the HHs. The percentage was almost similar in Schools (14%), wherein there is a possibility of additional chlorine being added locally for the purification of water. Even if 90% of samples passed in bacteriological parameter the RC was found only in 14%, which means the protection against the risk of bacteriological contamination from source to point of consumption is not provided to HHs. A monitoring system to ensure the correct dosing of chlorine in the pipe water supply system is necessary for assuring potable water.

Out of the 7828 HHs sampled for the FHTC assessment, a water quality test was carried out in 7580 due to the non-availability of water in 3% HHs on the day of the survey. pH was found within the acceptable limit in 95% of households. Among the public institution, pH was found in the acceptable limit of more than 95% in AWC, HF, and GP.

24% of villages in the state reported having available field test kits. Less than two-fifth of these reported to have either VWSC/Pani Samiti or pump operators trained to use field test kits for testing the quality of water on-site.

### **Water quality management in village**

It was found that 25% of villages in the state reported having a VWSC or a Pani Samiti out of which 25% of the VWSC/Pani Samitis reported to have more than 50% female members. In the state, 4% of villages reported that VWSC/ Pani Samiti is responsible for the operation and maintenance of pipe water supply.

17% of villages reported having identified skilled manpower for O&M of PWS schemes. 18% of villages in the state reported having faced challenges with respect to O&M of PWS schemes.

90% of HHs reported that they are aware of any grievance redressal mechanism w.r.t. HH tap water through PWS, but only 13% HHs have reported a complaint in the last year and only 8% of complaints have been resolved. Among those who reported complaints (i.e., 13% HHs, 1016 HHs), 75% of the HHs reported their complaints to the pump operators besides other reporting channels.

Overall, 57% of villages in the state levy charge for water service delivery to households whereas 70% HHs reported paying water service delivery charges at the households.

94% of HHs reported that their daily requirement of water was being met by HH tap connections.

Overall, 95% of HHs reported using an improved source of drinking water, as their primary source. The state also needs to further strengthen communication for the quality of water supplied so that every household can use the same for drinking purposes.

Overall, 49% HHs reported using booster pumps to maximize the water flow through their piped water connections.

It was found that 15% of the villages have schemes that are based on groundwater sources, while 28% on surface water sources.

Age-wise functionality of the schemes indicates improvement in 'always functional' schemes and a decrease in the 'non-functional scheme' in the state since 2012. 8-% point improvement in a fully functional scheme was recorded from 2012 to 2013-18. In 2019 and later the trend

reversed, however, 46% of schemes have been reported to be always functional and 2% as partially functional (i.e., a total of 48% of schemes).

### **Impact of JJM**

Across the state, only 2% HHs reported having an incidence(s) of water-borne diseases in the last year.

Since having a functional HH tap connection, 25% HHs across the state have reported that there has been a change in the no. of employment days of the adult HH members while 54% HHs reported no change.

Out of the HHs reported (i.e., 5848) that female members used to fetch water before HH tap connection, 85% reported that post-installation of HH tap connection helped reduce of time and effort in collection of water.

Across the state, 6% HHs reported that since having a functional HH tap connection the attendance of the girls going to schools has increased, while 31% HHs reported no change in attendance which could possibly be an impact of shutting down of schools due to COVID-19 related lockdown during the survey period.

### **Functionality Status of Har Ghar Jal Districts**

At the state level for Har Ghar Jal districts, 98% of households received water on the day of the survey. While 64% of the households were found to have fully functional tap connections. Out of which 90% received an adequate quantity of water, more than three-fourth reported receiving a fully regular supply of water and 92% received potable water.

Since having a functional HH tap connection, 21% reported that there has been a change in no. of employment days. Out of the HHs in which female members used to fetch water before HH tap connection, 93% reported that post-installation of HH tap connection helped reduce time and effort in collecting water. Across the Har Ghar Jal districts, 38% HHs reported that since having a functional HH tap connection their income has directly benefitted.

### **Functionality Status of Aspirational Districts**

At the state level for aspirational districts, 98% of households received water on the day of the survey. While 43% of the households were found to have fully functional tap connections. Out of which 92% received an adequate quantity of water, more than four-fifths reported receiving a fully regular supply of water and 50% received potable water.

Since having a functional HH tap connection, 13% reported that there has been a change in no. of employment days. Out of the HHs in which female members used to fetch water before HH tap connection, 88% reported that post-installation of HH tap connection helped reduce time and effort in collecting water. Across the aspirational district, 82% HHs reported that since having a functional HH tap connection their income has directly benefitted.



## 1. State Factsheet

Functionality status of tap connection at households	India	J&K
Working tap connections- HHs which received water through tap connection at least once in last 7 days (%)	86	97
Quantity <sup>1</sup> of water received by households		
Adequate quantity (>55 LPCD) (%)	85	84
Partially adequate quantity (> 40 LPCD - < 55 LPCD) (%)	5	6
Inadequate quantity (<40 LPCD) (%)	10	10
Regularity <sup>2</sup> of water received by households		
Fully Regular Supply (as per schedule) (%)	80	70
Partially Regular Supply (not as per schedule) (%)	14	18
Irregular Supply (less than 9 months' supply) (%)	6	12
Potable <sup>3</sup> (Quality) water received by households (%)	87	86
Overall functionality <sup>4</sup> (%)	62	53

Service delivery parameters	India	J&K
Overall user satisfaction on regularity at the household level (%)	83	80
Overall user satisfaction on quality at the household level (%)	82	82
Households receiving water supply daily-7 days a week (%)	74	81
Daily HH requirement of water being met by FHTC (%)	80	94
Households paying water service delivery charges (%)	35	70
Households aware of grievance redressal mechanism (%)	71	90
Households reported a reduction in time and effort in collecting water (%)	79	85
Average no. of times water is supplied in a day	1	1
Households reported incidence of water-borne diseases in the last year (%)	2	2
Households purifying water before drinking (%)	57	78
Residual Chlorine (RCL) detected with in permissible limits (%)	24	14
Villages with Field Test Kits (%)	30	24
Villages in which bacteriological test was done in last 1 year by VWSC/ Pani Samiti (%)	29	22
Villages reported to have a mechanism for chlorination (%)	21	19

Institutional arrangement	India	J&K
Village reported having presence of VWSC/ Pani Samiti (%)	38	25
Villages in which VWSC/ Pani Samiti is responsible for Operation & Maintenance of PWS schemes (%)	14	4
Villages in which persons are trained to use Field Test Kits (%)	31	18
Villages levying water service delivery to households (%)	34	57
Villages having skilled manpower for Operation & Maintenance of PWS schemes (%)	31	17
Community monitoring of water wastage in villages (%)	19	7
Villages in which signages about JJM were observed (%)	15	4

<sup>1</sup> Quantity (in litres) of water received by households per person per day should meet the service level of 55 lpcd

<sup>2</sup> Regularity is receiving water for 12 months or daily basis as per schedule

<sup>3</sup> Potable water has been considered basis testing of water samples through laboratory tests for physical, chemical, and bacteriological parameters (within acceptable/ permissible range) and onsite testing of pH.

<sup>4</sup> Overall functionality has been computed as the intersection of Adequate Quantity, Fully Regular Supply and Potable (Quality) for households wherein water supply was available at the time of survey


Functionality status of tap connection at households in Har Ghar Jal Districts	India	J&K
Working tap connections- HHs which received water through tap connection at least once in last 7 days (%)	91	98
Quantity of water received by households		
Adequate quantity (>55 LPCD) (%)	88	90
Partially adequate quantity (> 40 LPCD - < 55 LPCD) (%)	4	5
Inadequate quantity (<40 LPCD) (%)	8	5
Regularity of water received by households		
Fully Regular Supply (as per schedule) (%)	84	76
Partially Regular Supply (not as per schedule) (%)	11	16
Irregular Supply (less than 9 months' supply) (%)	5	8
Potable (Quality) water received by households (%)	90	92
Overall functionality (%)	69	64

Functionality status of tap connection at households in Aspirational Districts	India	J&K
Working tap connections- HHs which received water through tap connection at least once in last 7 days (%)	78	98
Quantity of water received by households		
Adequate quantity (>55 LPCD) (%)	85	92
Partially adequate quantity (> 40 LPCD - < 55 LPCD) (%)	5	4
Inadequate quantity (<40 LPCD) (%)	10	4
Regularity of water received by households		
Fully Regular Supply (as per schedule) (%)	77	88
Partially Regular Supply (not as per schedule) (%)	14	10
Irregular Supply (less than 9 months' supply) (%)	9	2
Potable (Quality) water received by households (%)	88	50
Overall functionality (%)	62	43

## 2. Context

Jal Jeevan Mission (JJM) was launched on the 15th of August 2019 with the objective to provide functional household tap connections (FHTCs) to all rural households.

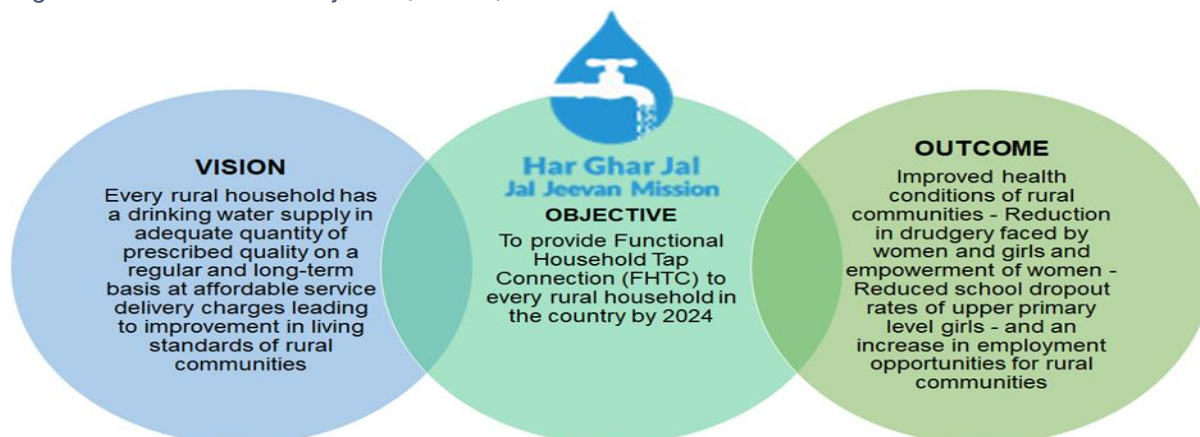Figure 1: Har Ghar Jal - Objective, Vision, & Outcome



In accordance with the overall objectives as specified in the Operational Guidelines for the implementation of the NJJM, GoI carried out a sample survey to assess the functionality of household tap connections. As part of this endeavour, NJJM, GoI engaged HTA Kantar Public to conduct the 'Functionality Assessment' of the household as well as public institution/buildings such as schools, anganwadis, gram panchayat buildings, public health facilities, and wellness centers in all the rural districts for the fiscal year 2021-22.

### 2.1. State snapshot: Jammu & Kashmir

The state of Jammu & Kashmir lies on the northern part of India and has a population of 1,22,67,013 people. It has 20 districts and 6,887 villages where 6,486 villages have PWS schemes. The state lies on the Western Himalayan region and receives an average annual rainfall of about 1256.1mm. Among the villages with PWS schemes, 5525 villages (80.22%) have more than 20 households with functional tap connections. The state is yet to achieve the Har Ghar Jal status.

Presented here are state level information collated from the DDWS-IMIS:

Figure 2: State IMIS Status & Map

#### IMIS status:


- Not a Har Ghar Jal state
- 6 districts are iron and 4 are fluoride affected
- 5525 (80.22% of all) villages with PWS more than 20 FHTC
- 22.63% villages covered under HH tap connections under HGJ



## 2.2. FHTC Assessment Objectives

The overall objectives of the FHTC assessment are as presented:

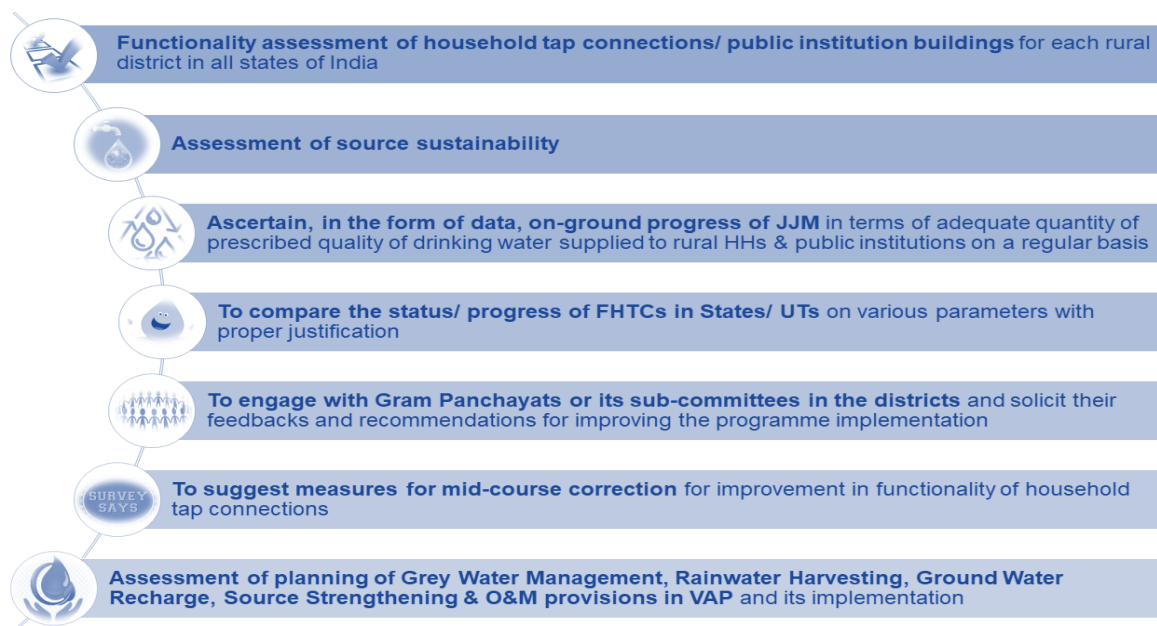
Figure 4: FHTC Assessment Objectives



## 2.3. Assessment Methodology

A cross-section research design has been used for this functionality assessment study. Quantitative data were collected from villages and households across all states/UTs using the CAPI (Computer Assisted Personal Interviewing) mode. The survey includes two components, village, and household.

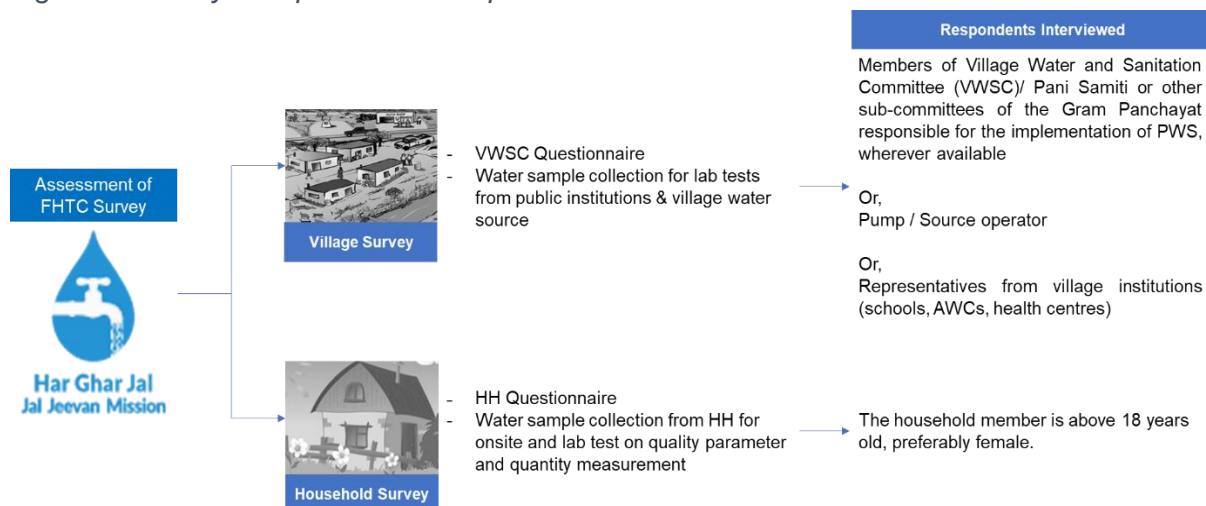Figure 5: Survey Components & Respondents



## 2.4. Sample Size

The sample size was calculated to provide estimates with a 95% confidence interval (CI) and 5% margin of error (MoE) after incorporating the correction factor for a finite population considering the total number of geographic units having FHTCs.

- Village sample is estimated to be representative at the state level
- HH sample estimated to be representative at the district level

- Number of Har Ghar Jal (HGJ) villages were proportionately sampled at the district level
- All PWS schemes (up to 4) were covered per village. Per scheme approximately 9 (3 each from the head, middle, and tail HHs) or 18 households (6 each from head, middle, and tail HHs) were sampled to achieve the desired sample at the district level.

## 2.5. Sampling Methodology


As per the design, all villages having a PWS scheme with 20 or more functional household tap connections were included in the sample frame. The probability proportionate to size (PPS) method was used for village selection in each district. The steps for random selection of villages using PPS are presented below:

Figure 6: Steps for Random Sampling of Villages



Figure 7: Household Selection

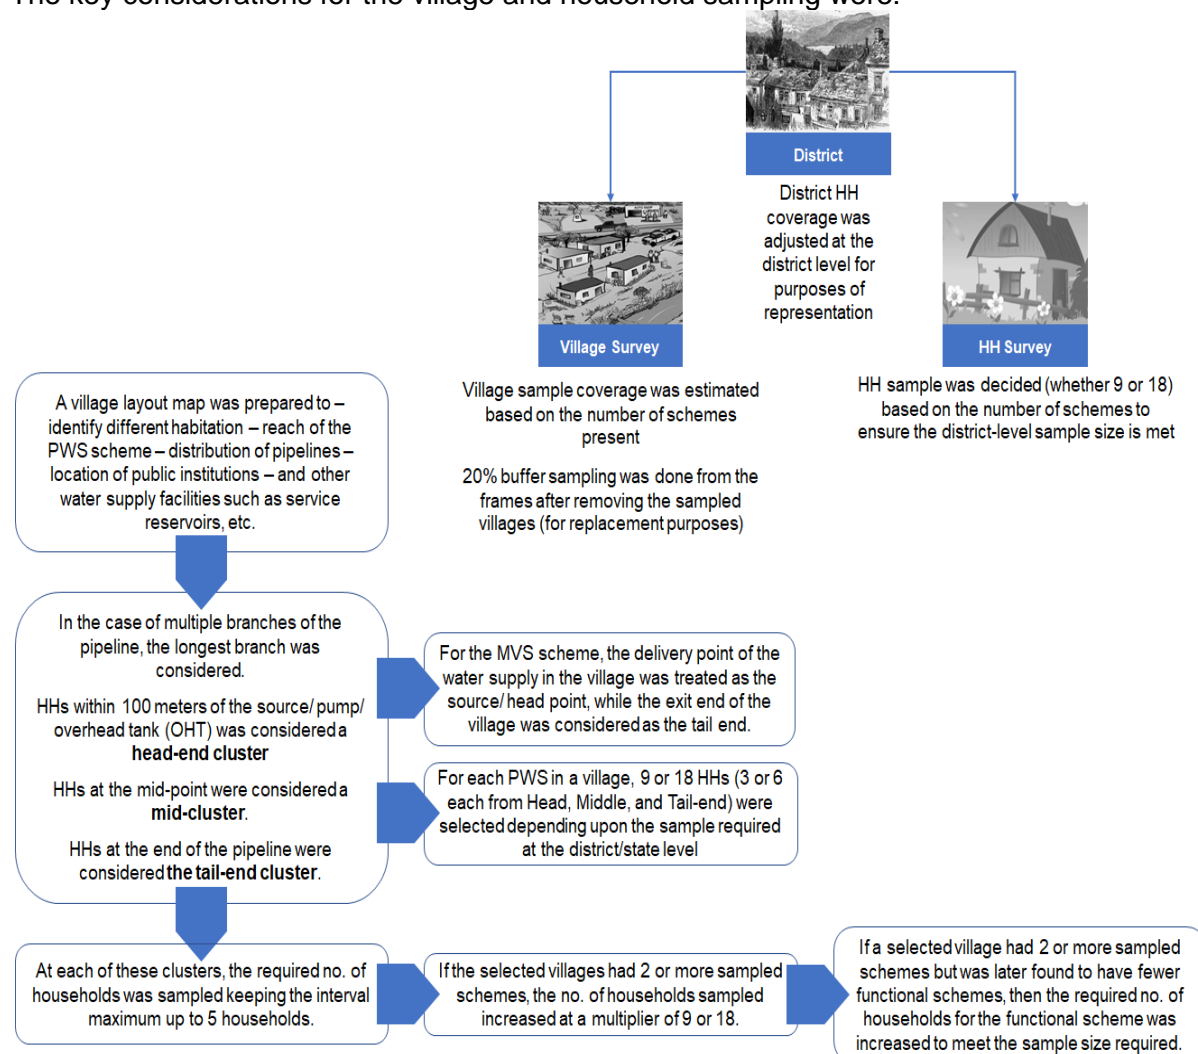The key considerations for the village and household sampling were:




The record of all district-wise village replacements is maintained and reported as part of the annexure.

## 2.6. Methodology for Water Quantity Measurement at Households

The flow rate of the water supply was measured using a container with gradual markings (either 5 litres or 1 litre, based on the flow of the tap) and a stopwatch/timer-watch. The process followed is as described in Figure 6.

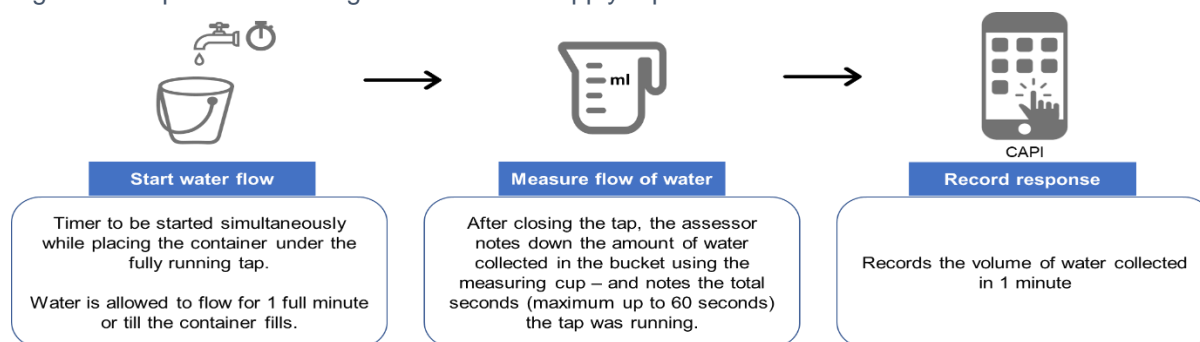Figure 8: Steps for Measuring Flowrate from Supply-tap at HHs



In the case of households where the FHTC is connected directly with the storage tank, the following steps were adopted to measure the quantity:

- Assessor first asked and recorded length, breadth, and height.
- Assessor dipped a 5 feet long rod, marked the level of the water table, and calculated the volume – length x breadth x-height of water.
- Next the assessor opened the valve of the connection and allowed the water to flow inside the storage for 10 minutes.
- After 10 mins, the valve was closed, and the assessor again dipped the rod and recorded the new height of the water inside the tank. Based on this new 'height' and the CAPI calculated the changed volume.
- The difference in the volume of water in 10 minutes divided by 10 provided the flow rate of the water supply per minute.


The water flow rate was not measured for village-level public institutions.

## 2.7. Methodology for Water Quality Measurement

Water quality was tested for all public institutions available in the villages, including schools, AWCs, gram panchayat buildings, public health facilities, and wellness centers, and at the selected households. Two types of quality tests were carried out – a) spot test for pH and free residual chlorine, and b) water sample was collected and transported to labs for testing against 13 quality parameters (total 15) as specified in Figure 7.



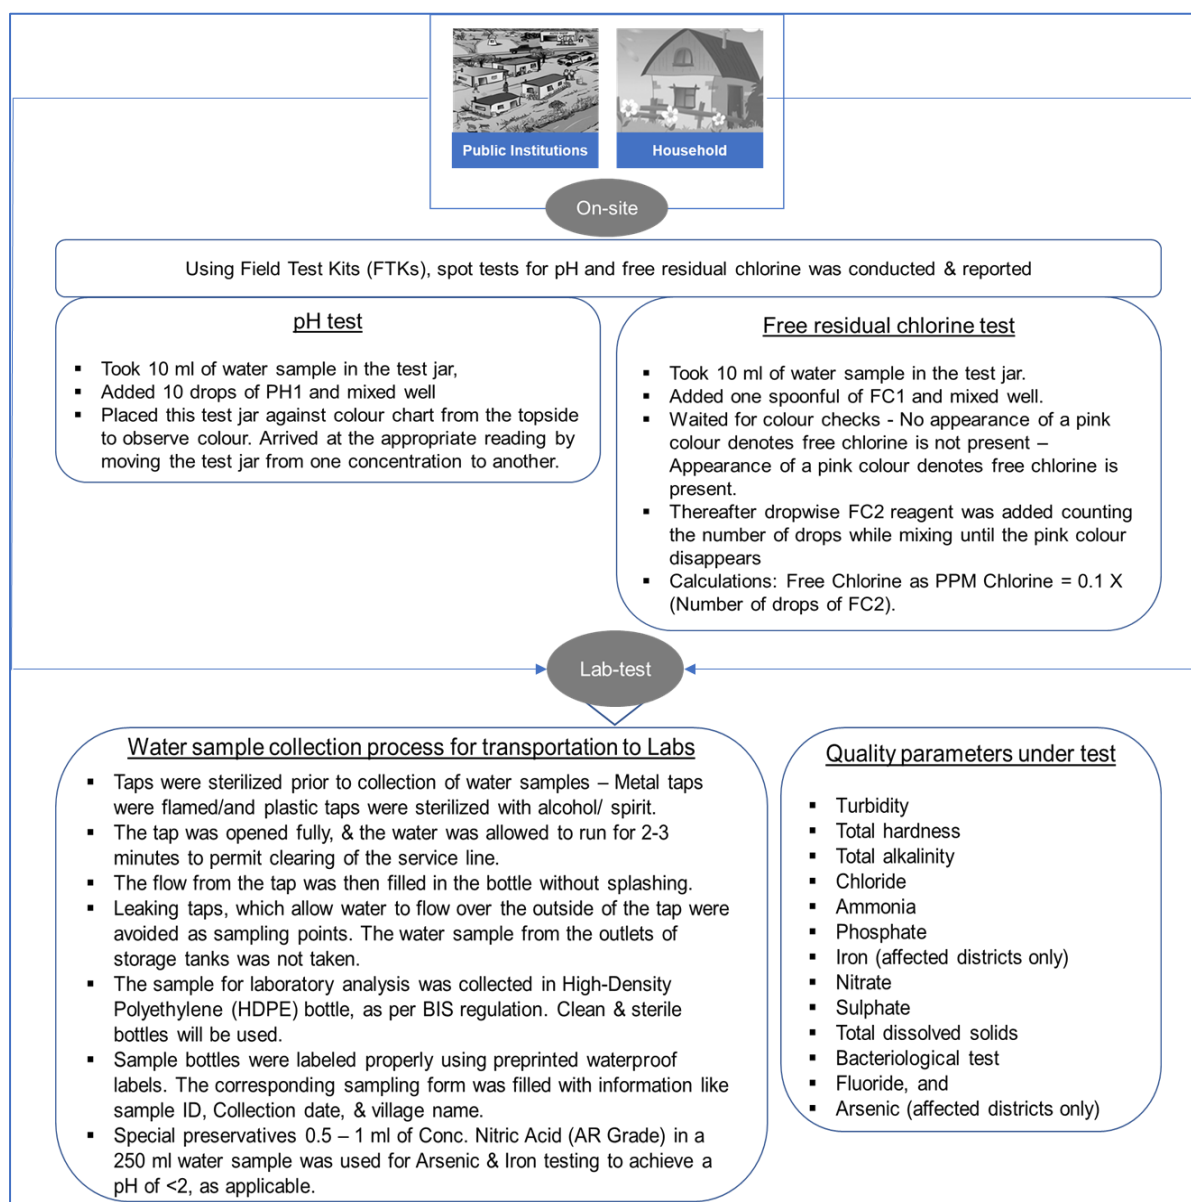Figure 9: On-site & Laboratory-Based Quality Test




JJM, with the support of the BMI Division of ICMR, enabled a new interface on the WQMIS portal for “Functionality Assessment (FA) User” to enable seamless harmonization of water sample registration, and sample submission for testing, and sharing of results as per the applicable quality parameters.

## 2.8. Project Implementation

An overview of the project implementation is as presented:

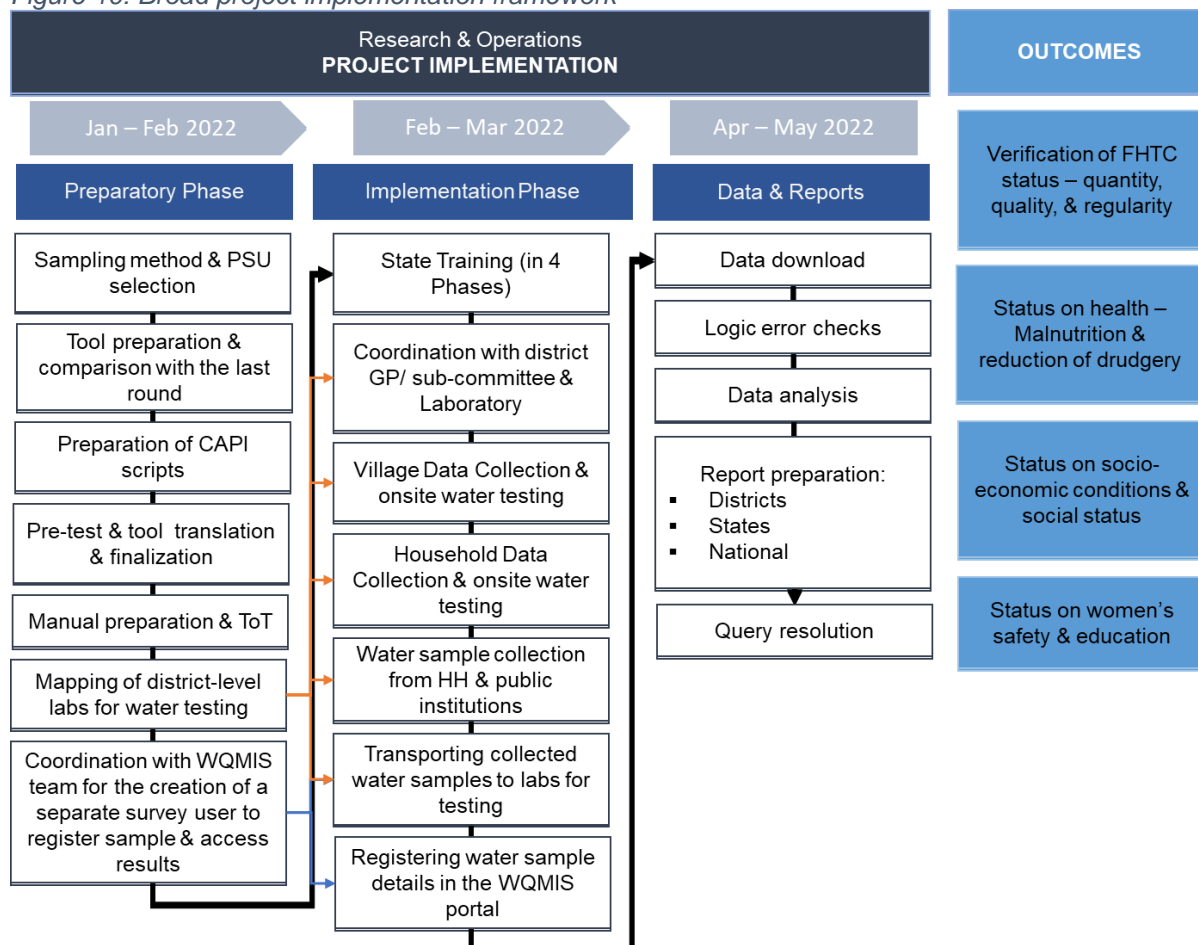Figure 10: Broad project implementation framework



A total of 10 teams (comprising 10 supervisors, 60 assessors, and 10 water collection assistants) were recruited, trained, and deployed to complete the survey across the states of Jammu & Kashmir. One survey team covered approximately 2 – 3 districts. The state-wise team deployment and fieldwork dates were as presented:

Table No. 1: Team deployment and data collection start & end dates

States	Teams deployed	Start date	End date	Total data collection days
Jammu & Kashmir	10 Teams	10 <sup>th</sup> March	15 <sup>th</sup> April	35 Days

A four-tier quality control (QC) system was put in place. At the ground level, the data collection exercise was done using a computer-aided Personal Interview (CAPI) application which contained all logic and skip-checks inbuilt. Also, 5% of the total samples were accompanied by the supervisors. Sub-targeted QC was done by the state field managers (5%) and the central project management team (5%). Apart from this, the central research team monitored the data trend and as per requirement debriefed data collection teams to improve quality.

## 2.9. Sample coverage

Table No. 2: Sample covered							
State	Targeted sample			Achieved sample			
	District	Village	HH	District	Village	HHs	PIs
India	712	13,300	3,00,000	712	13299	3,01,389	16,148
Jammu & Kashmir	20	359	7,641	20	365	7,780	674

## 2.10. Sampled village and household profile


SAMPLED VILLAGES	SAMPLED HOUSEHOLDS
<ul style="list-style-type: none"> <li>Total no. of villages covered in the state – <b>365</b></li> <li>Percentage of SC dominated villages – <b>5.6%</b> (while at national level the average is 12.6%)</li> <li>Percentage of ST dominated villages – <b>13.1%</b> (while at national level the average is <b>20.2%</b>)</li> <li>Higher proportion of <b>pump operators</b> interviewed at the village level</li> <li><b>8.8%</b> of the villages reported to have any historical incidence of water contamination</li> </ul>	<ul style="list-style-type: none"> <li>Total no. of households covered in the state – <b>7780 (Respondents: Male 5678, Female 2102)</b></li> <li>Proportion of General – <b>80.3%</b>, SC <b>8.7%</b>, ST <b>8.2%</b>, OBC <b>2.9%</b> households</li> <li><b>27.0%</b> of the FHTC connections are under the name of a female member</li> <li>Average household size – <b>6.2</b></li> <li><b>100%</b> positive user experience in 5/5 measures</li> </ul>

### 3. Findings

#### 3.1. Functionality status of FHTC at household level

##### A. Overall Functionality\* (in %)

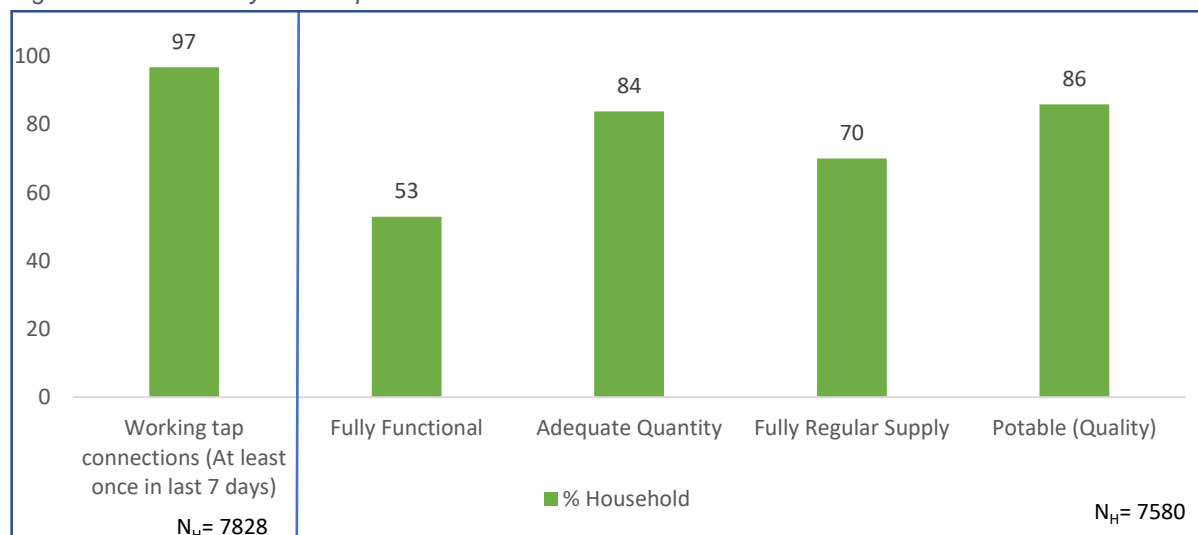Figure 11: Functionality of HH tap connection



\* Fully Functional has been computed as = Adequate Quantity  $\cap$  Fully Regular Supply  $\cap$  Potable (Quality)

Please note: Henceforth, N<sub>H</sub>=7580 implies all HHs where water was found on the day of the survey.

It has been found that 97 percent of the sampled HHs (N=7828) had working tap connections. Moreover, more than 4 out of 5 households (84 percent) received adequate quantity ( $\geq 55$  LPCD) water supply and more than two-third received regular supply (70 percent) of water. The on-site testing and lab test results of the water indicates that more than four-fifth (86%) of the sampled households in the state receive potable water.

Out of the 7828 HHs sampled for the FHTC assessment, water was not available in 248 households on the day of the survey.

S. No.	District	Working tap connections (HHs which received water through FHTC at least once in the last 7 days) (% HH)	Adequate Quantity (% HH)	Full Regular Supply (% HH)	Potable (Quality) (% HH)
1.	Kathua	76	46	49	70
2.	Udhampur	82	70	64	100
3.	Reasi	93	95	89	99
4.	Rajauri	95	72	78	94
5.	Baramulla	95	92	90	25
6.	Jammu	97	83	95	100
7.	<b>JAMMU AND KASHMIR</b>	<b>97</b>	<b>84</b>	<b>70</b>	<b>86</b>
8.	Srinagar	98	100	90	91
9.	Shopian	100	75	45	58
10.	Kupwara	100	92	87	73
11.	Kulgam	100	95	51	82
12.	Pulwama	100	94	88	83
13.	Poonch	100	87	93	93

Table No. 3: Quantity, Regularity, and Quality of FHTC at the district level (%HH)					
S. No.	District	Working tap connections (HHs which received water through FHTC at least once in the last 7 days) (% HH)	Adequate Quantity (% HH)	Full Regular Supply (% HH)	Potable (Quality) (% HH)
14.	Budgam	100	86	44	94
15.	Samba	100	80	49	94
16.	Anantnag	100	96	71	95
17.	Bandipora	100	74	81	97
18.	Ganderbal	100	81	82	98
19.	Kishtwar	100	69	16	98
20.	Ramban	100	93	94	99
21.	Doda	100	87	48	100
# Potable water has been considered basis testing of water samples through laboratory tests for physical, chemical, and bacteriological as given in Table 5 parameters (within acceptable/ permissible range) and onsite testing of pH. The details of laboratory test are mentioned in the table given above in the glossary.					
JE-AES Affected		Aspirational Districts	Aspirational & JE-AES Affected		


District level comparison across the districts indicate that Kathua, Udhampur, Reasi, Rajauri, Baramulla, and Jammu reported functionality less than the state average. The districts of Yamunanagar, Panchkula, Ambala, Karnal, Charkhi Dadri, Faridabad, Kurukshetra, and Panipat FHTC provide more than 55 LPCD of water in more than 95 percent HHs.

More than 90 percent HHs in the districts of Jammu, Poonch and Ramban reported to regularly receive water through FHTC. Regular supply of water is less than 50 percent in the districts of Kishtwar, Kathua, Budgam, Shopian, Doda, and Samba.

Potability of water was found to be more than 95 percent in the districts of Anantnag, Bandipora, Ganderbal, Ramban, Doda, Udhampur, and Jammu. Whereas in the district of Baramulla the potability of water was found less than 50 percent.

## B. District wise functionality status

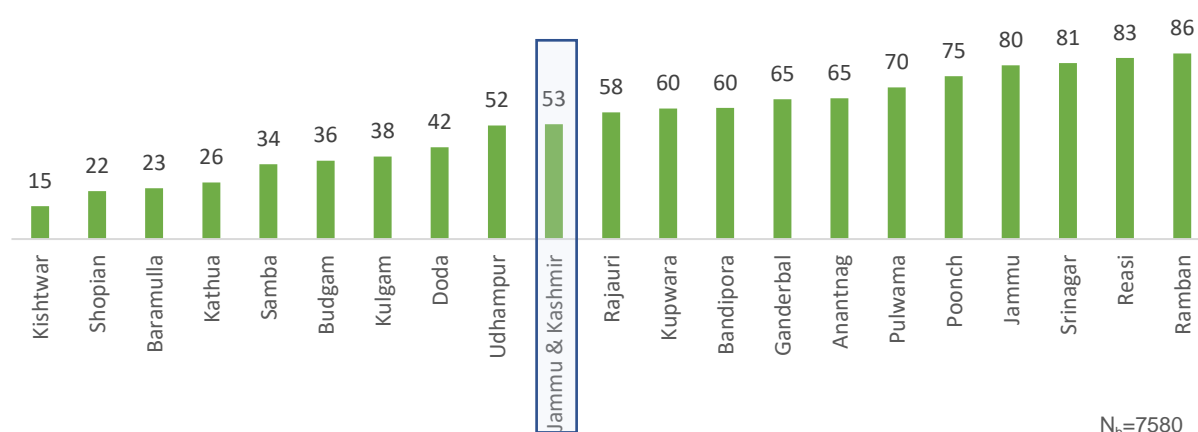Figure 12: District wise Functionality of HH tap connection



\* 'Functionality' has been computed as the intersection of Adequate Quantity, Fully Regular Supply and Potable (Quality) for households wherein water supply was available at the time of survey, i.e., 7580 HHs.


**53 percent HHs** in the state were found to have functional HH tap water connection. Ramban district reported 86 percent functional households in the state, followed by Reasi, Srinagar, and Jammu with more than 80 percent functionality. In the districts of Baramulla, Shopian and

Kishtwar less than one-fourth of the households have functional HH tap water connection highlighting scope for improved service delivery.

### C. Age vs functionality of schemes in the villages

More than 4 out of 10 schemes were functional before 2012 and more than 5 out of 10 were functional from 2013-18 which reflects a 8-point increase, but trend reversal was observed from 2019 and later reflecting 6-point decline.

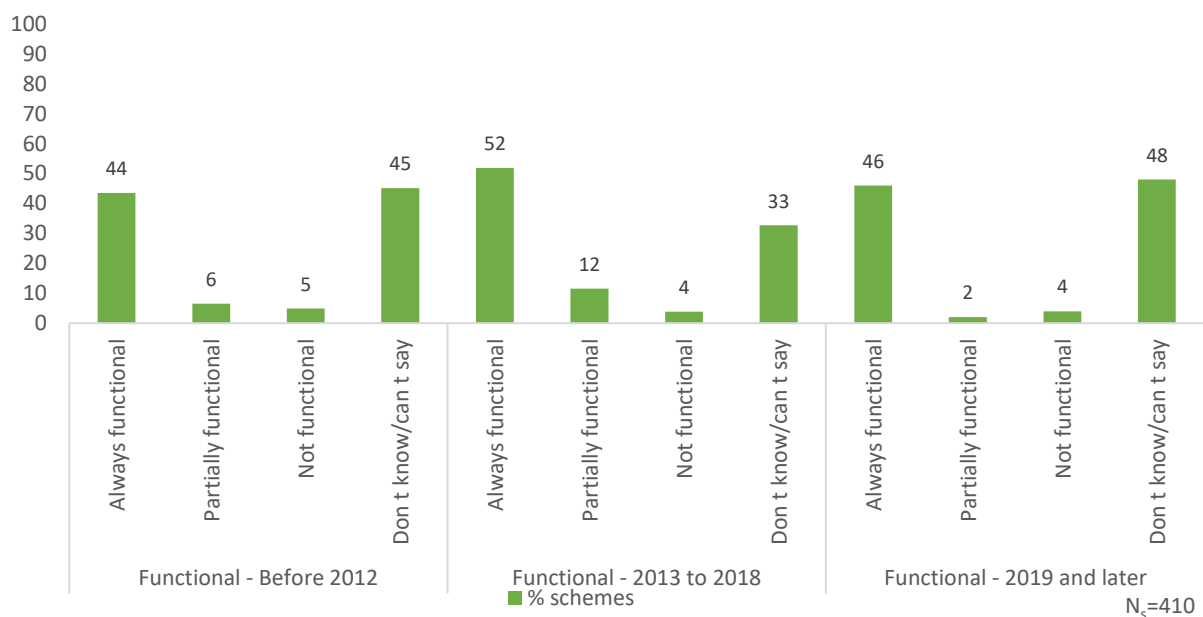Figure 13: Age vs functionality of schemes in the villages






### 3.2. Quantity, Regularity, and Quality of Water

Under JJM, functionality is defined as having infrastructure, i.e., household tap connection providing water in adequate quantity (55 LPCD or more) of prescribed quality on regular basis (every day or as decided by GP and/ or its sub-committee) with adequate pressure. It also includes long-term source and system sustainability. For the purposes of this survey, the quality parameters are defined and measured on a set of 15 indicators (of which 2 indicators are tested on-site and for 13 indicators water samples have been sent to the laboratories), as mentioned in the glossary section.

#### A. Water quantity measured as LPCD (Litres per Capita per Day)


**84% HHs** reported receiving adequate quantity of water (more than 55 LPCD of water)

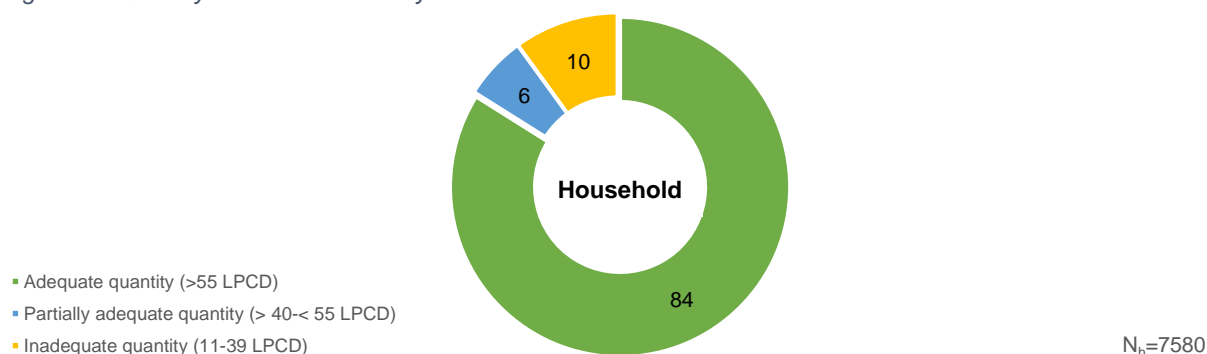Figure 14: Quantity of water received by households



#### Quantity of water received across head, middle, and tail end

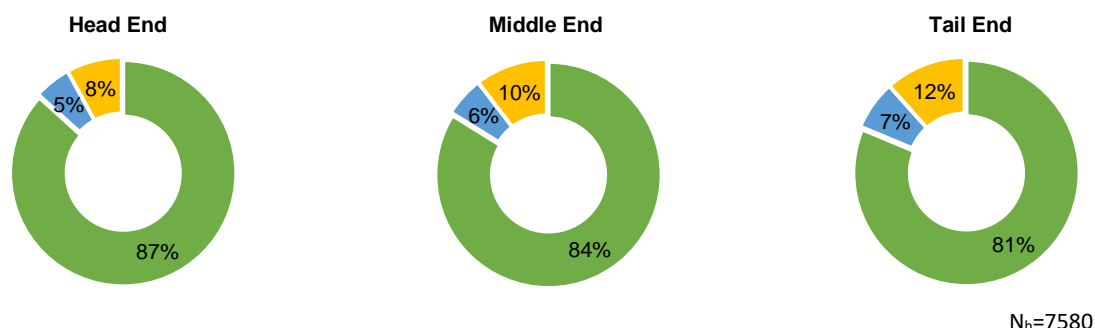
Figure 15: Quantity of water received across head, middle and tail end households



The quantity of water received across the head, middle, and the tail end was observed to have declined, and about four-fifth (84%) of the sampled households received water in adequate quantity, i.e., greater than or equal to 55 LPCD.


### Types of water storage arrangements at village level (in %)

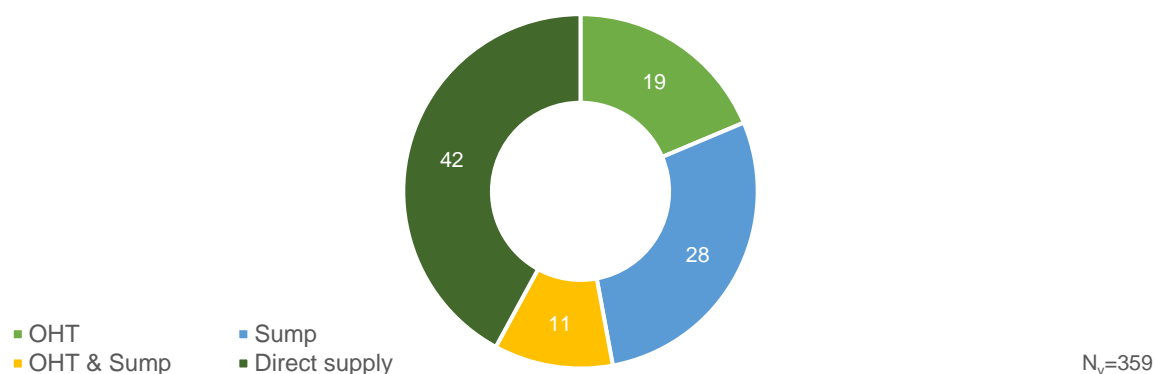Figure 16: Pipe water supply storage available in village



More than two out of three respondents in the state reported water being directly supplied. And in 28 percent reported water being stored in sum.

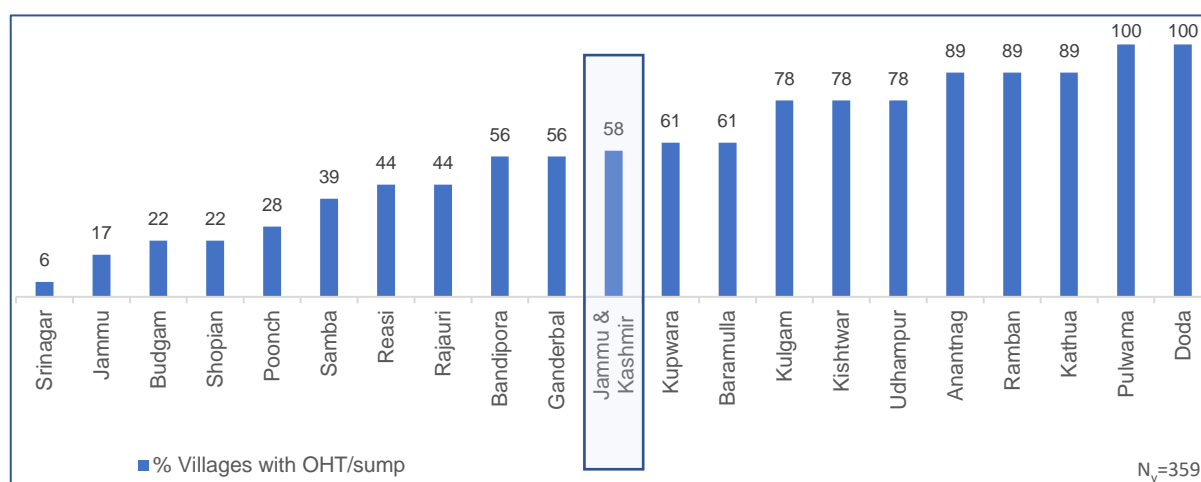Figure 17: District wise water storage arrangements at village level (% villages with OHT/ Sump)




**58 percent villages** in the state have either an OHT or a sump for storing water for supplying to the households. Doda and Pulwama are the only districts where all the villages have either an OHT or a sump, followed Kathua, Ramban and Anantnag where more than four-fifth of the villages have facilities to store water for supplying to the households.

## B. Regularity of water supply to households


**70% HHs** receive a regular supply of water (as per agreed schedule).

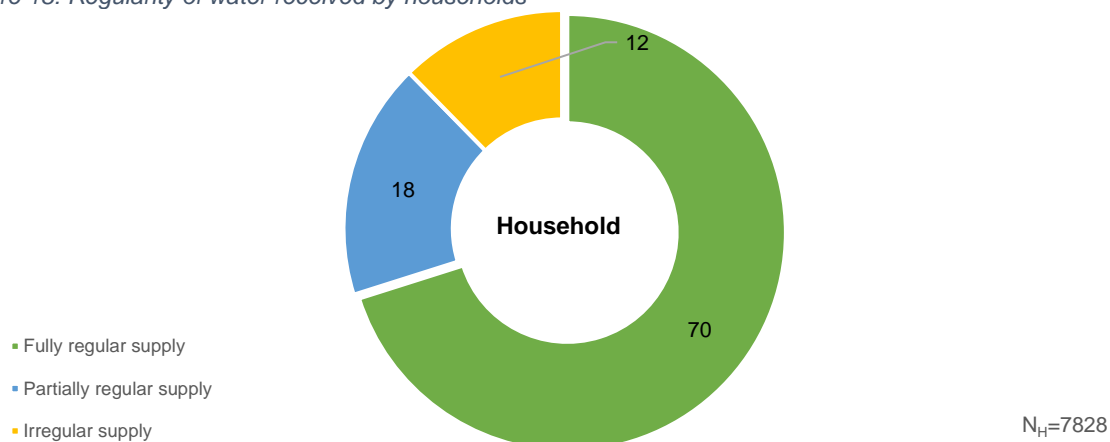Figure 18: Regularity of water received by households




### Regularity of water received across head, mid, and tail end

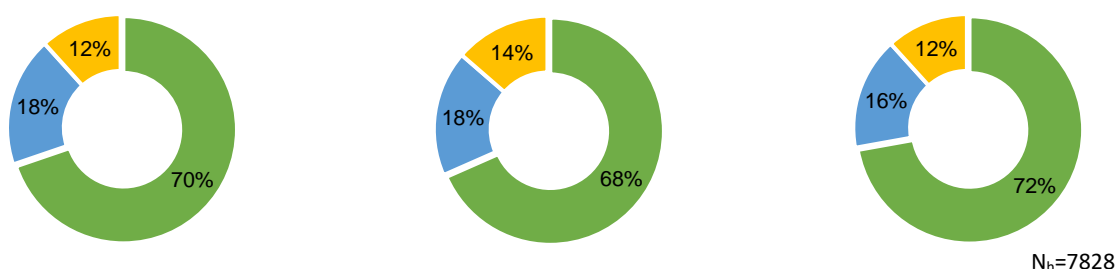Figure 19: Regularity of water received across head, middle and tail end households



Water is more regularly available at the tail-end households of the PWS in comparison to the head end.

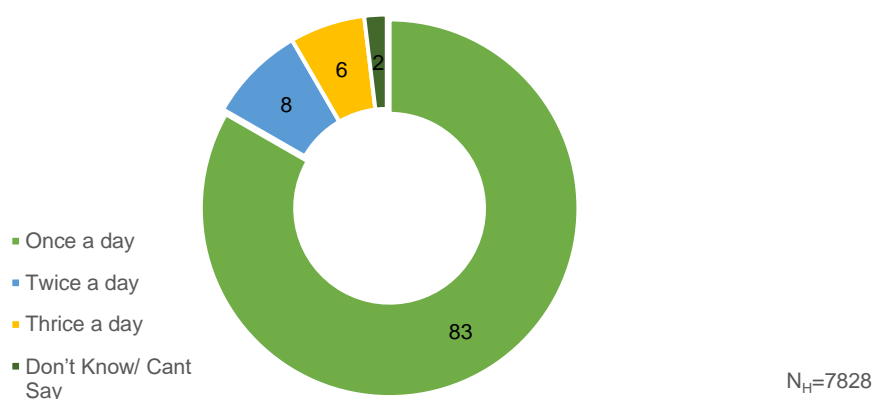
Figure 20: Average no. of times water is supplied in a day



HHs in **83% of districts** receive water once a day. The average duration of water supply across the state was reported to be **2 hours per day**.

### Average water supply days in a week to households

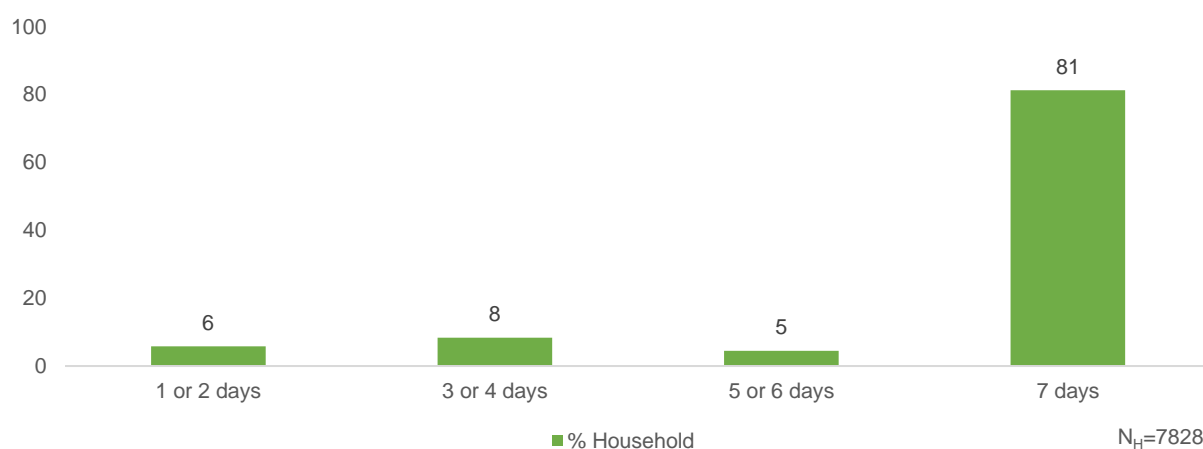
Figure 21: Average number of days households receive water supply in a week (in %)



**81 percent of HHs** reported receiving water for all 7 days in a week (daily).

### C. Potability Water – Quality

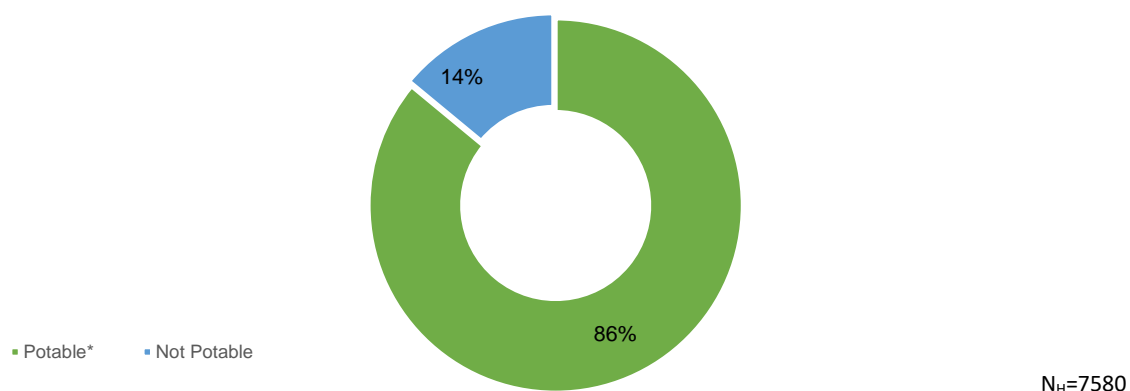Figure 22: Potable water received by households



*\*Potable water has been considered basis testing of water samples through laboratory tests for physical, chemical and bacteriological as given in Table 5 parameters (within acceptable/ permissible range) and onsite testing of pH. The details of laboratory test are mentioned in the table given above in the glossary.*

Among the sampled households in Jammu and Kashmir where water was found on the day of the survey, the potability of water was found to be 86%.

**Table No. 4: Village quality parameters reported within permissible range (% sample within permissible range)**

Quality Parameters (N <sub>v</sub> =359)	Water Samples Tested from Public Institutes			
	Anganwadi Centre	Health Facility	Schools	Others
pH (on-site)	97	96	94	93
Turbidity	86	100	84	100
Total Hardness	100	100	100	100
Total Alkalinity	100	100	100	
Chloride	100	100	100	100
Ammonia	100	100	100	
Iron	98	100	97	100
Nitrate	100	100	100	100
Sulphate	100	100	100	
Total Dissolved Solids	100	100	100	100
Bacteriological Test (Absence)	Not Tested			
Fluoride	100	100	99	100
Arsenic	100		100	

**Table No. 5: Household water quality parameters reported within permissible range (in % sample within permissible range)**

The number of water samples submitted to the laboratory for the calculation of the different parameters was the same as mentioned in the rest of the report (sample size for HH water submitted to labs=8923). However, the below data are presented based on the results received from the laboratories and the respective base sizes are mentioned for each of the parameters separately.

Quality Parameters	No of water samples tested	% Samples within permissible range
pH (on-site)	7580	95
Turbidity	3845	84
Total Hardness	3727	100
Total Alkalinity	2276	100
Chloride	2765	100
Ammonia	326	100
Iron	3908	97
Nitrate	3777	100
Sulphate	1356	100
Total Dissolved Solids	2669	100
Bacteriological Test (Absence)	2635	98
Fluoride	3783	100
Arsenic	210	99

### Safeguarding piped water supply for unforeseen bacteriological contamination- Presence of Residual Chlorine (RC)

The Residual Chlorine (RC) in the state of Jammu and Kashmir was found in 14% samples. 3% samples were having RC outside range whereas 82% samples, had no RC. 98% of water samples passed the bacteriological contamination test. While in 2% samples bacteriological contamination is found, out of which there was no samples that had chlorine in permissible range while in 2% samples there was no chlorination and there was no sample which had RC outside range.

The Residual Chlorine in piped water supply is one of the most important preventive actions to assure quality of water against bacteriological contamination from source to consumption. The presence of residual chlorine within permissible limits is indicator of well-maintained and healthy piped water supply system.

It is advised that behavioural change communication campaigns on appropriate dosage of residual chlorine is held in all villages and monitoring system for chlorine dosing is established. The FTK must have residual chlorine testing facility for effective WQM&S.

### Comment on functioning of District Lab:

The district lab tested water samples for 12 water quality parameters. 8254 water samples were submitted, and 5854 water samples were tested, and reports made available. The turnaround time for testing was more than 48 hours in most cases. Given this feedback, it can be conferred that these labs have limited scope to take up samples from the general public at large on a regular basis.

Table No. 6: Performance of Labs						
Sl. No	District	Lab available	HH surveyed	Samples submitted	Report received	Overall lab experience
1	Kupwara	Yes	402	449	384	The labs did not have any issue with testing the number of water samples submitted nor had any issues with human resource, reagents etc however only concern was the lab did not receive any sample of weekends and public holidays
2	Baramulla	Yes	389	433	342	The labs did not have any issue with testing the number of water samples submitted nor had any issues with human resource, reagents etc however only concern was the lab did not receive any sample of weekends and public holidays
3	Bandipora	Yes	399	435	163	The labs did not have any issue with testing the number of water samples submitted nor had any issues with human resource, reagents etc however only concern was the lab did not receive any sample of weekends and public holidays
4	Ganderbal	Yes	400	428	379	The labs did not have any issue with testing the number of water samples submitted nor had any issues with human resource, reagents etc however only concern was the lab did not receive any sample of weekends and public holidays




<b>Table No. 6: Performance of Labs</b>						
<b>Sl. No</b>	<b>District</b>	<b>Lab available</b>	<b>HH surveyed</b>	<b>Samples submitted</b>	<b>Report received</b>	<b>Overall lab experience</b>
5	Srinagar	Yes	389	403	311	The labs did not have any issue with testing the number of water samples submitted nor had any issues with human resource, reagents etc however only concern was the lab did not receive any sample of weekends and public holidays
6	Budgam	Yes	394	431	418	The labs did not have any issue with testing the number of water samples submitted nor had any issues with human resource, reagents etc however only concern was the lab did not receive any sample of weekends and public holidays
7	Pulwama	Yes	406	443	431	The labs did not have any issue with testing the number of water samples submitted nor had any issues with human resource, reagents etc however only concern was the lab did not receive any sample of weekends and public holidays
8	Shopian	Yes	379	404	160	The labs did not have any issue with testing the number of water samples submitted nor had any issues with human resource, reagents etc however only concern was the lab did not receive any sample of weekends and public holidays
9	Anantnag	Yes	385	428	232	The labs did not have any issue with testing the number of water samples submitted nor had any issues with human resource, reagents etc however only concern was the lab did not receive any sample of weekends and public holidays
10	Kulgam	Yes	420	501	409	The labs did not have any issue with testing the number of water samples submitted nor had any issues with human resource, reagents etc however only concern was the lab did not receive any sample of weekends and public holidays
11	Ramban	Yes	387	422	24	The labs did not have any issue with testing the number of water samples submitted nor had any issues with human resource, reagents etc however only concern was the lab did not receive any sample of weekends and public holidays
12	Doda	Yes	390	432	403	The labs did not have any issue with testing the number of water samples submitted nor had any issues with human resource, reagents etc however only concern was the lab did not receive any sample of weekends and public holidays
13	Kishtwar	Yes	401	437	252	The labs did not have any issue with testing the number of water samples submitted nor had any

Table No. 6: Performance of Labs						
Sl. No	District	Lab available	HH surveyed	Samples submitted	Report received	Overall lab experience
						issues with human resource, reagents etc however only concern was the lab did not receive any sample of weekends and public holidays
14	Reasi	Yes	397	379	346	The labs did not have capacity to test more than 60 number of samples and had issues of human resource, reagents etc."
15	Udhampur	Yes	386	316	312	The labs did not have capacity to test more than 60 number of samples and had issues of human resource, reagents etc."
16	Poonch	Yes	394	439	427	The labs did not have any issue with testing the number of water samples submitted nor had any issues with human resource, reagents etc however only concern was the lab did not receive any sample of weekends and public holidays
17	Rajauri	Yes	379	388	363	The labs did not have capacity to test more than 60 number of samples and had issues of human resource, reagents etc."
18	Jammu	Yes	359	361	101	The labs did not have capacity to test more than 60 number of samples and had issues of human resource, reagents etc."
19	Samba	Yes	383	420	136	The labs did not have capacity to test more than 60 number of samples and had issues of human resource, reagents etc."
20	Kathua	Yes	389	305	261	The labs did not have capacity to test more than 60 number of samples and had issues of human resource, reagents etc."

**Households reported that their HH tap-water was collected and tested in the last one year**

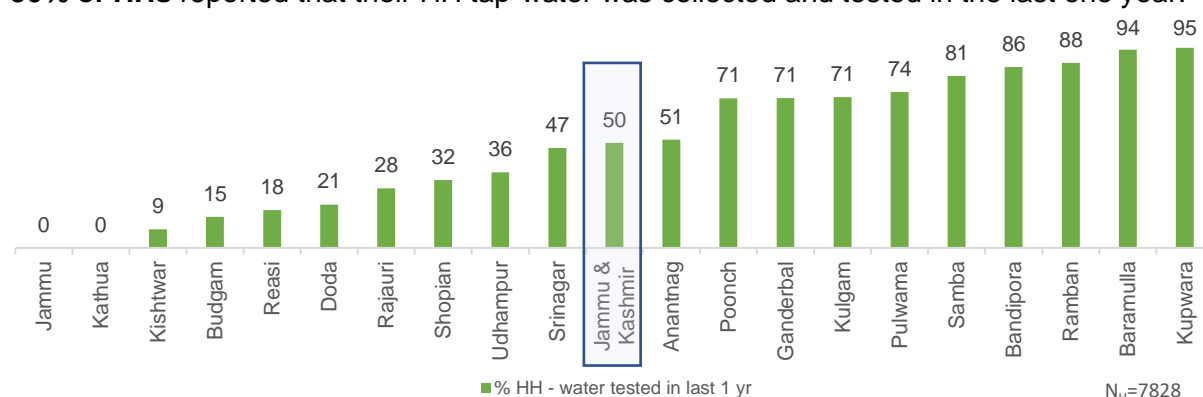**50% of HHs reported that their HH tap-water was collected and tested in the last one year.**




### 3.3. Operation and Maintenance (O&M) of schemes at village level

#### Schemes reported to have faced challenge in village

The Mini solar scheme faced the most challenges (21%) in comparison to the other schemes in the state

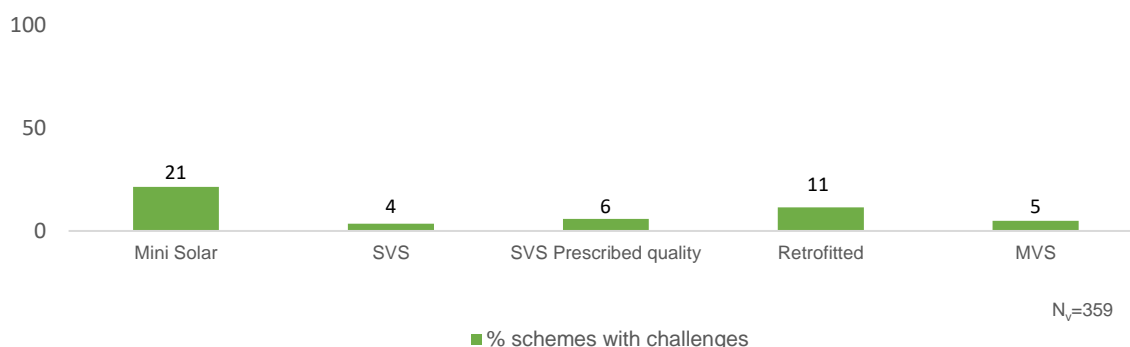
Figure 23: Schemes reported to have faced challenge in village



#### Type of challenge faced by the schemes

The most faced problem varied from one scheme to another. However, 'leakage/damage to pipeline', 'Technical fault resulting in pump breakdown', 'Absence/unavailability of pump operator', 'Irregular power supply or lack of backup power' and 'Issue within MVS/ regional water network' were few problems that were found unanimously in all the schemes.

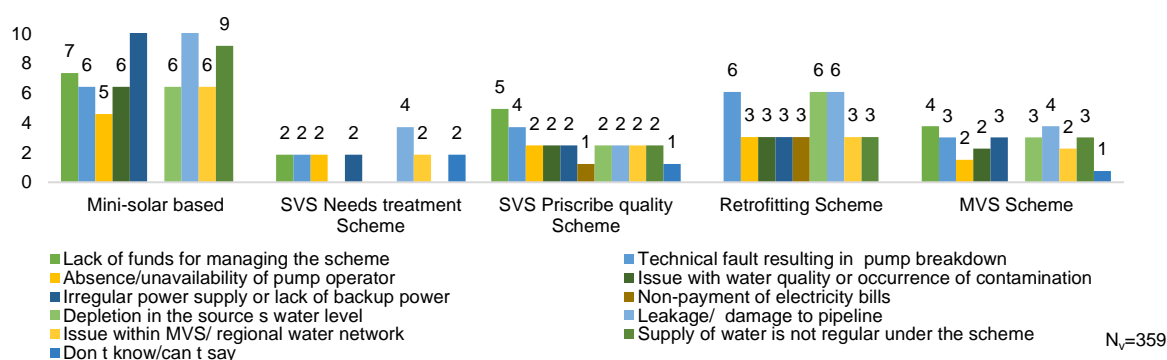
Figure 24: Type of challenge faced by the schemes



#### A. Presence of VWSC/Pani Samiti

25% of villages in the state reported to have a VWSC or a Pani Samiti.

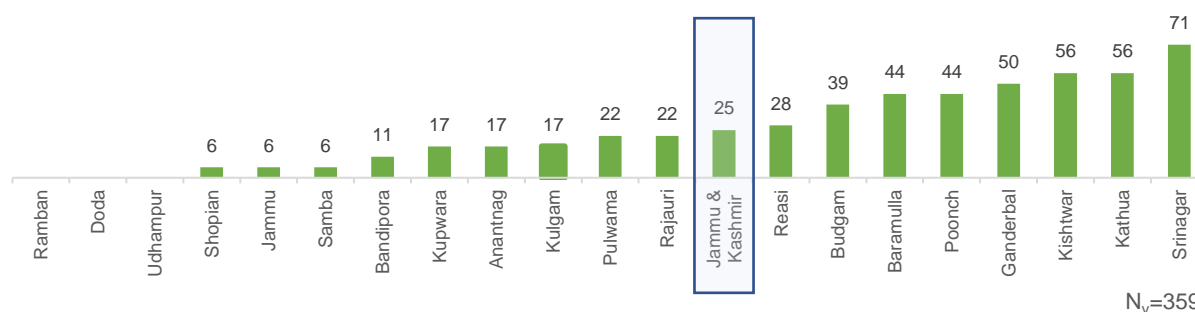
Figure 25: Villages where VWSC/ Pani Samiti is present



## B. VWSC/Pani Samiti with more than 50 percent female members

**25% of villages** in the state reported to have a VWSC or a Pani Samiti with more than 50% female members.

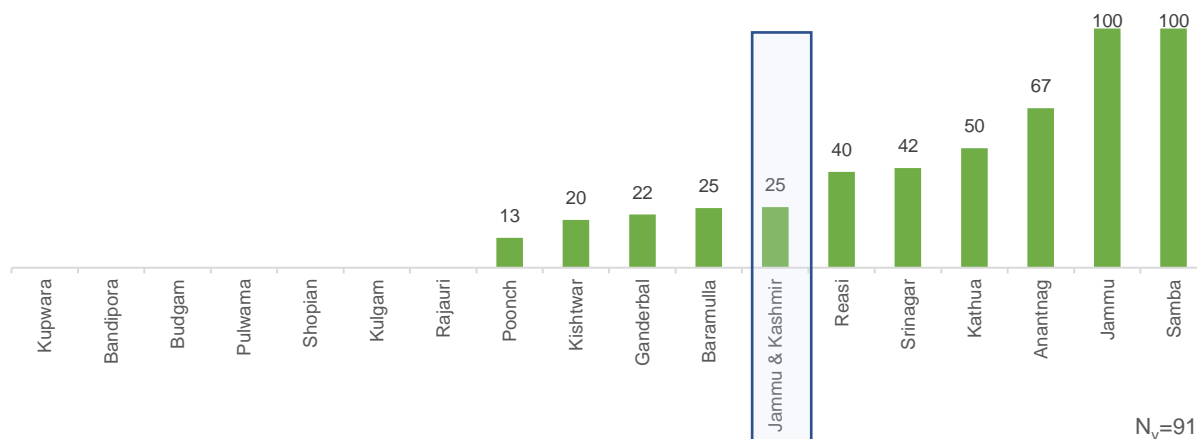
Figure 26: VWSC/ Pani Samiti with more than 50 percent female members



## C. VWSC Meetings in last one year

Across the villages in the state, that reported to have VWSC/Pani Samitis (91 villages), 2 meetings in last one year was reported the most (29%)

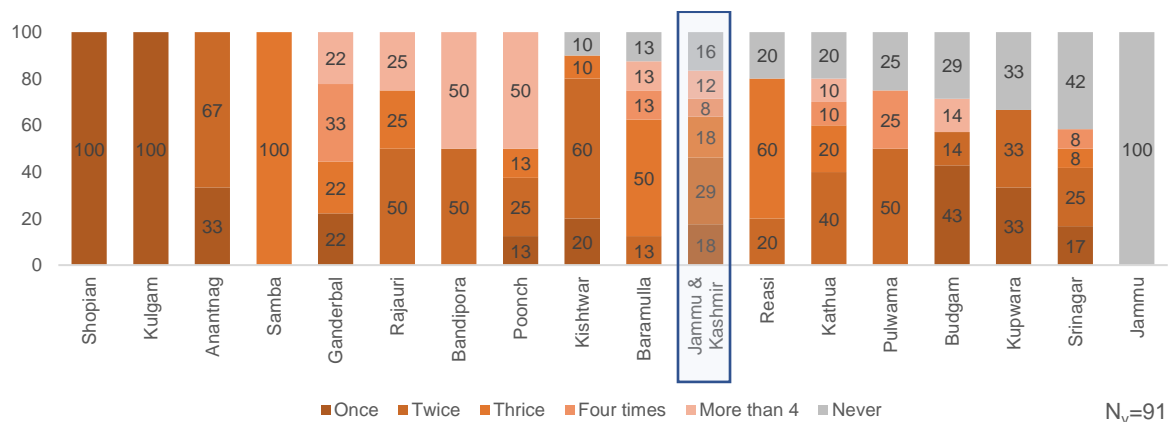
Figure 27: VWSC meetings held in last one year



### 3.4. Utilization of water at HHs for drinking and other activities


**94% of HHs** reported that their daily requirement of water was being met by HH tap connections

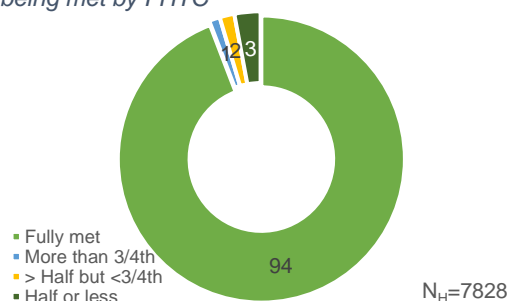Figure 28: Daily household's requirement of water being met by FHTC



**75% HHs** reported HH tap connections as their primary source of drinking water

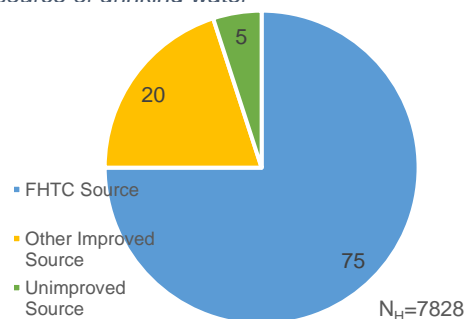
Figure 29: Households reported FHTC as primary source of drinking water



More than 9 out of 10 (94%) HHs reported their daily requirement of water being fully met by the HH tap connections. And 75 percent HHs reported used household tap connection for drinking water (primary source). 20 percent of the HHs even though have reported household tap connections to fully meet their requirements, were not found using the same for drinking purposes.

Overall, **95% of HHs** reported using improved primary source of drinking water, out of which **75% of HHs** reported HH tap water as their primary source.

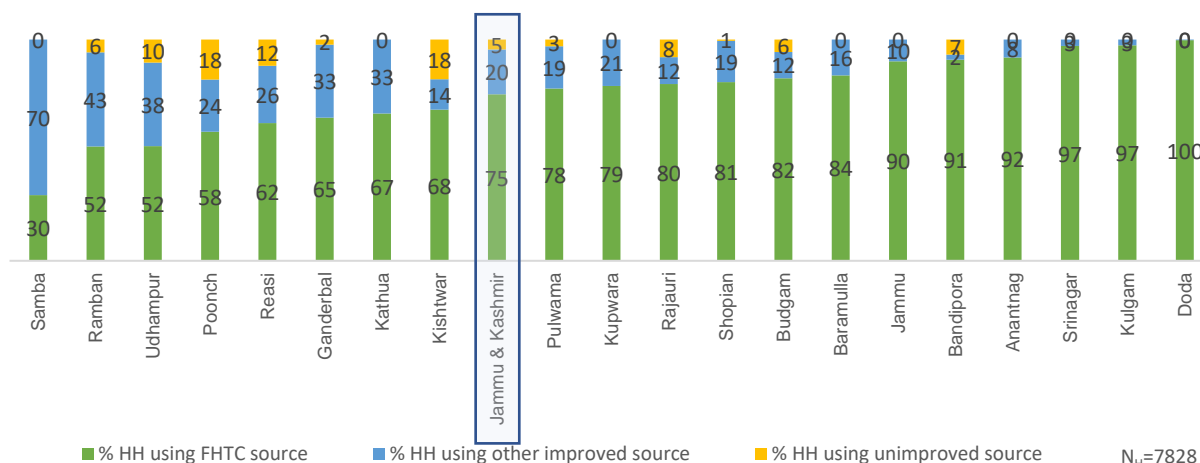
Figure 30: District wise distribution of household's reported FHTC as primary source of drinking water



## A. Households who practice of purifying water before drinking

Practice of purifying water before drinking was reported in all HHs in Shopian and Ganderbal (100%) wherein 81% HHs in Shopian and 65% HHs in Ganderbal reported using HH tap water as primary drinking water source, while the least was reported in Rajauri (6%) where 80% HHs reported using HH tap water as a primary drinking water source.

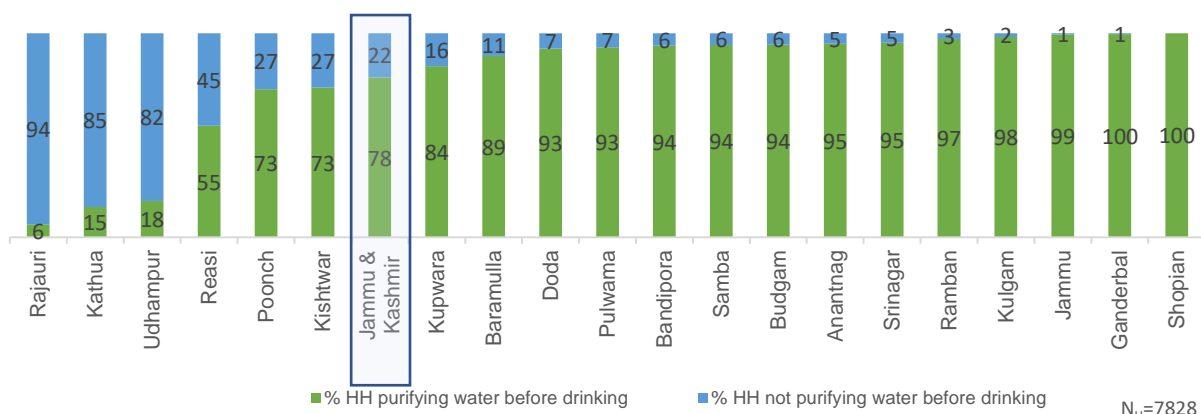
Figure 31: Households who practice of purifying water before drinking



## B. Households paying water service delivery charges

In Jammu and Kashmir, around 70% of the sampled households were found to be paying service delivery charges, Doda being the district with the highest percentage of such households (98%) and Rajouri being the district in which least percent of households reported paying any service delivery charges..

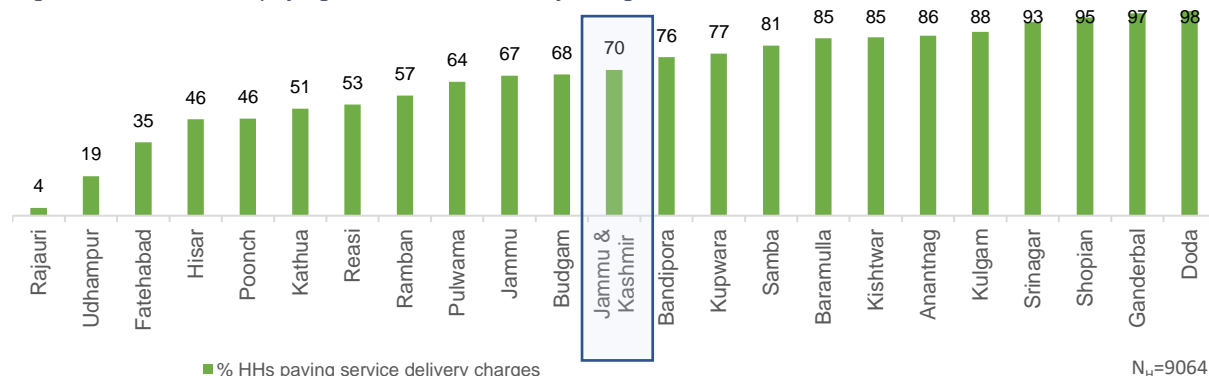Figure 32: Households paying water service delivery charges






### C. Storage mechanism used by households

Overall, 86 % households in Jammu and Kashmir were found to use some mechanism to store water in the household.

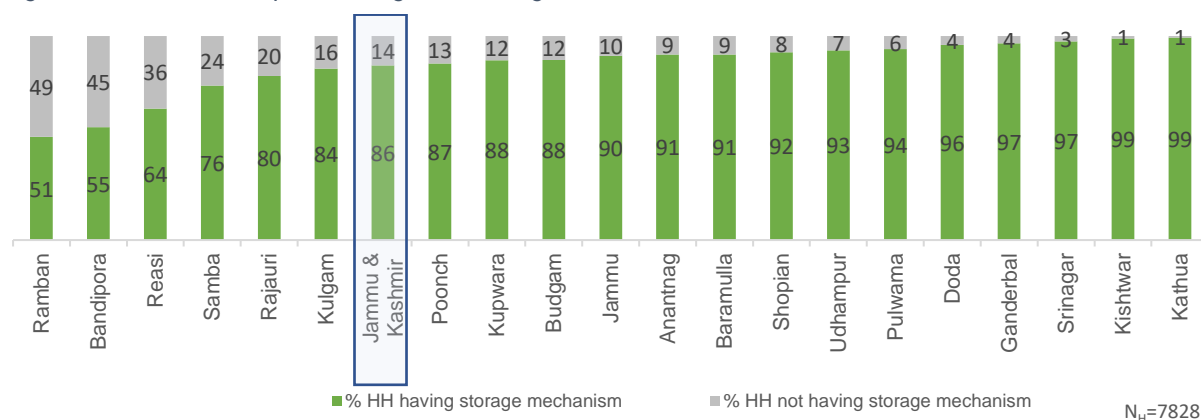
Figure 33: Households reported using some storage mechanism



### D. Households using booster pumps

Overall, **49% HHs** reported using booster pumps to maximize the water flow through their piped water connections. Kupwara and Baramulla reported 87% and 84% of HHs using booster pump in the state while Rajauri reported only 10%

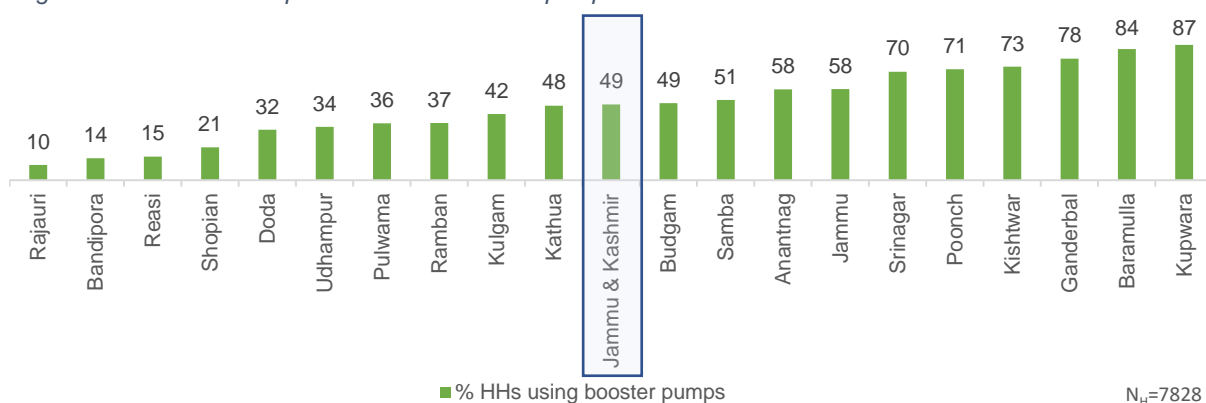
Figure 34: Households reported to use of booster pumps



### E. Households who faced shortage of water

In the state, **65% HHs** faced shortage of water during any time of the year.

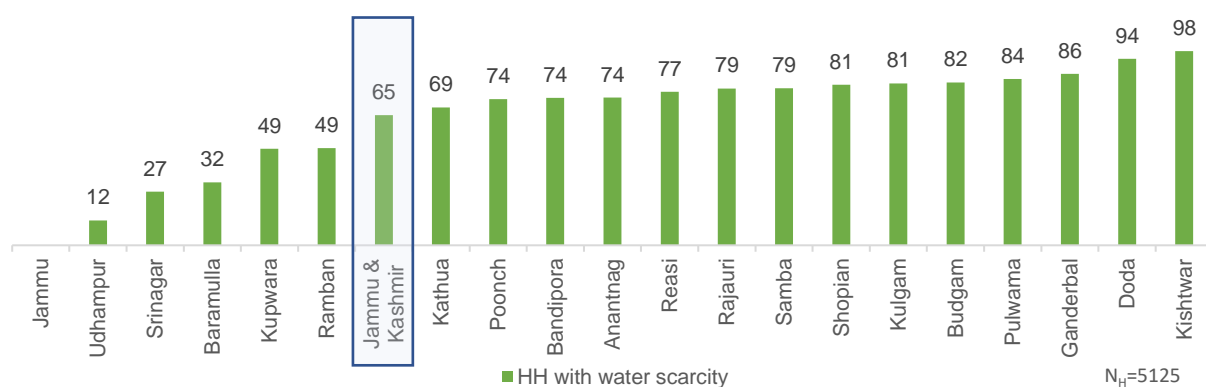
Figure 3533: Households who faced water scarcity



## F. Household with a mechanism to cope water scarcity

**62% HHs** reported having some mechanism to cope with scarcity of water.

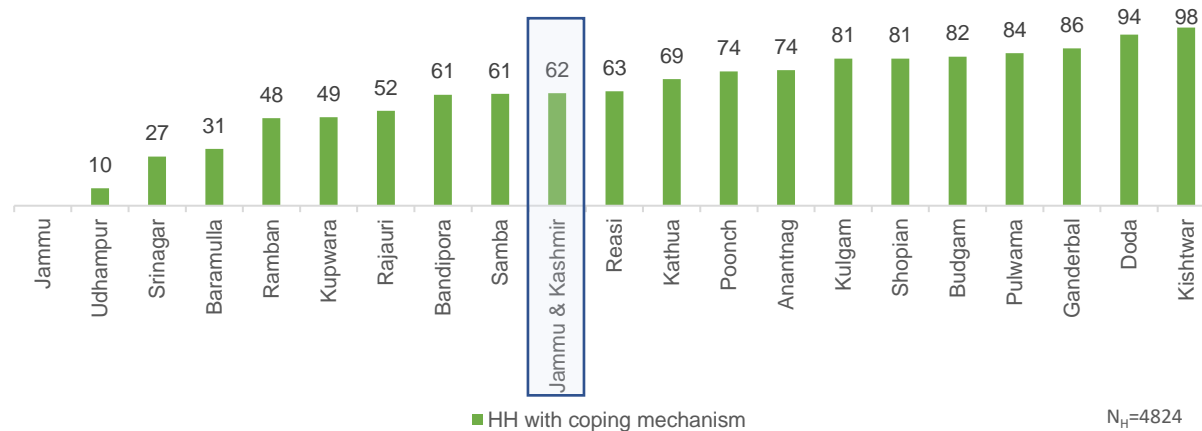Figure 36: Households reported to have some mechanism to cope with scarcity of water




### 3.5. Source sustainability at the village level

#### Schemes based on surface and ground water

**28% of schemes** reported to be based on surface water source while 15% of schemes reported to be based of ground water sources

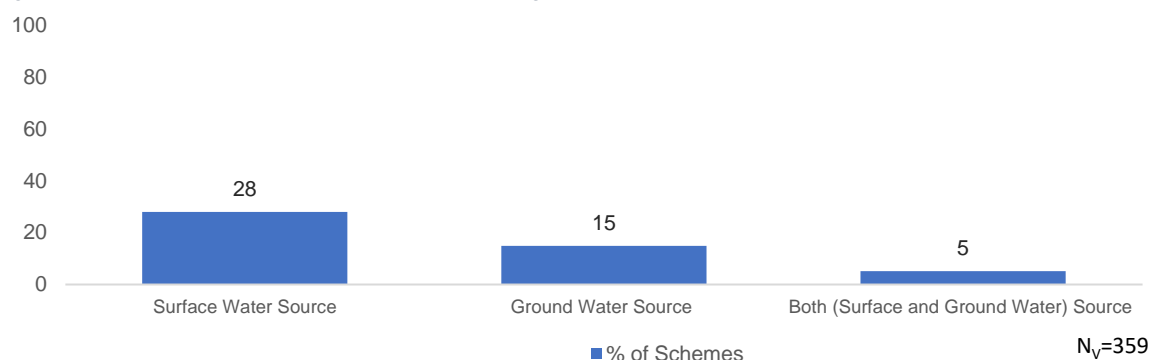Figure 37: Schemes based on water source in village




\*'Surface Water Source' is Stream, Spring, Glacier, River, lake, pond etc. and Groundwater Source is open well, borewell, tube well, handpump, spring, etc.

#### Presence of a groundwater source and groundwater recharging structure

In the state, **24% villages** reported the presence of groundwater sources like improved dug wells and borewells. Out of which, 8 percent of villages reported (i.e., 27 villages) reported having a recharge structure.

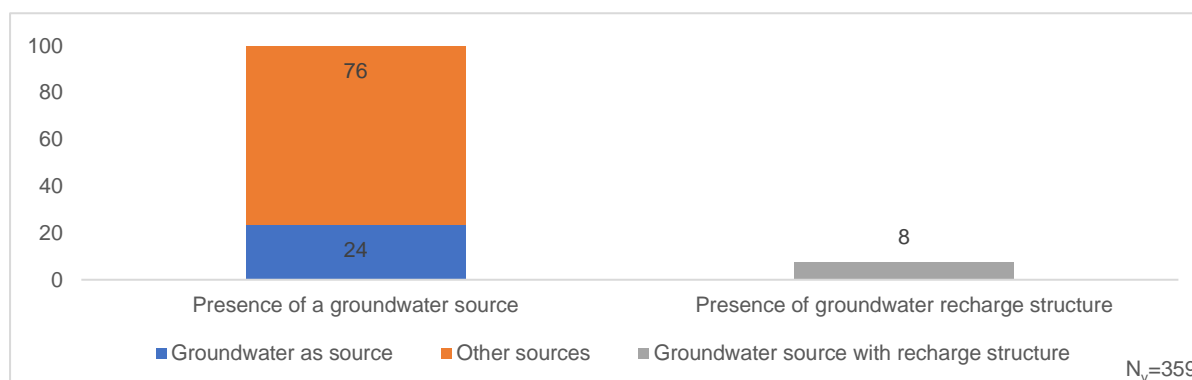
Figure 38: Villages reported the presence of groundwater sources and among those how many reported to have a recharge structure



### 3.6. Water quality monitoring and surveillance in the villages

#### A. Water quality management by VWSC: Availability of FTK with the Pani Samiti/ VWSC

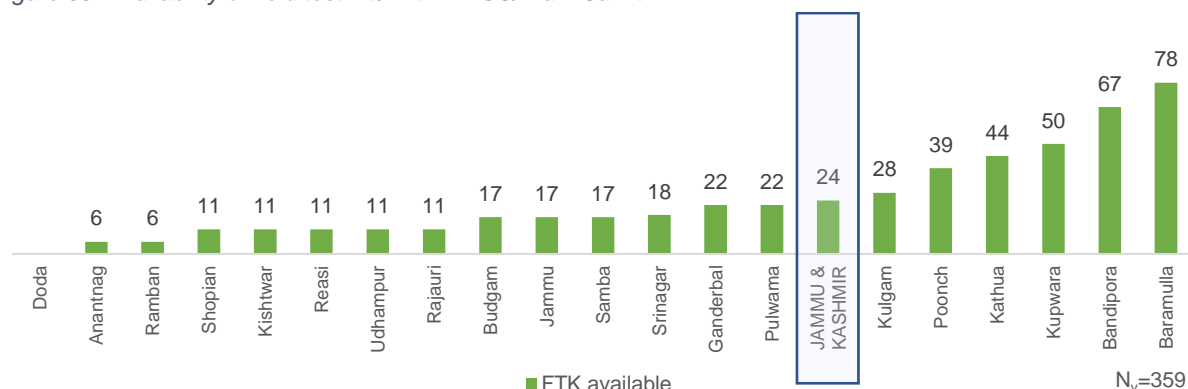
Figure 39: Availability of field test kits with VWSC/ Pani Samiti



With regards to water quality testing in the village by VWSC, 24% villages in the state reported having available field test kits. Baramulla reported 78% villages having available field test kits for water quality testing, while Doda reported none.

#### B. Persons trained to use field test kits in villages

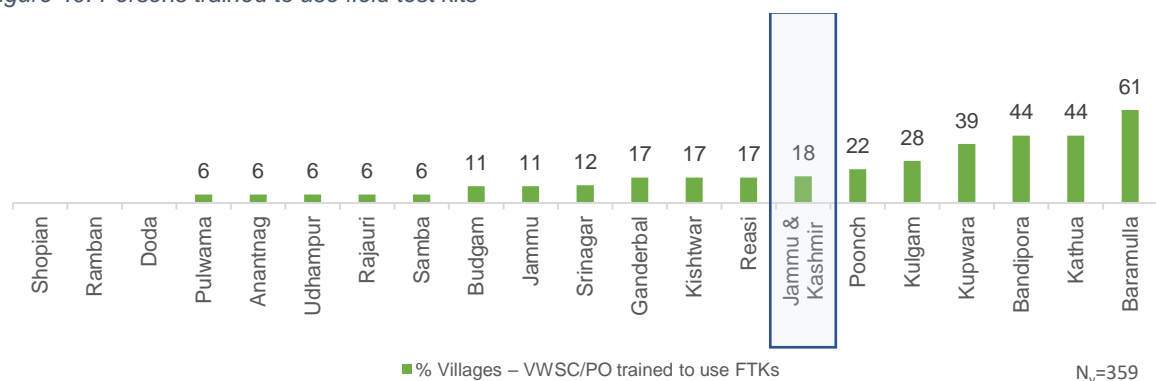
Figure 40: Persons trained to use field test kits



Overall, **18% of villages** in the state reported to have either VWSC/Pani Samiti or pump operator trained to use field test kits for testing the quality of water on-site. Baramulla reported 61% VWSC/Pani Samiti or pump operator trained to use field test kits while Shopian, Ramban and Doda reported 0%.

#### C. Water quality management by VWSC: Frequency of testing using FTK

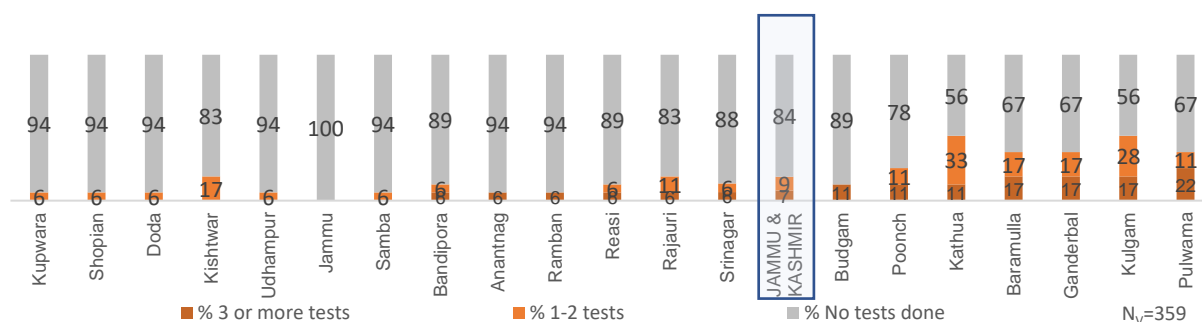
Figure 41: Frequency of testing using FTK in villages



Across the state, less than one-tenth of the total sampled villages (7%) reported that the quality of water (at different points in the respective villages) was checked at least three times using FTKs in last one year. Among the districts, Pulwama had the highest proportion of such villages, wherein 22% of its villages reported using FTKs three or more times in last one year.

## D. Water quality management by VWSC: Frequency of lab testing

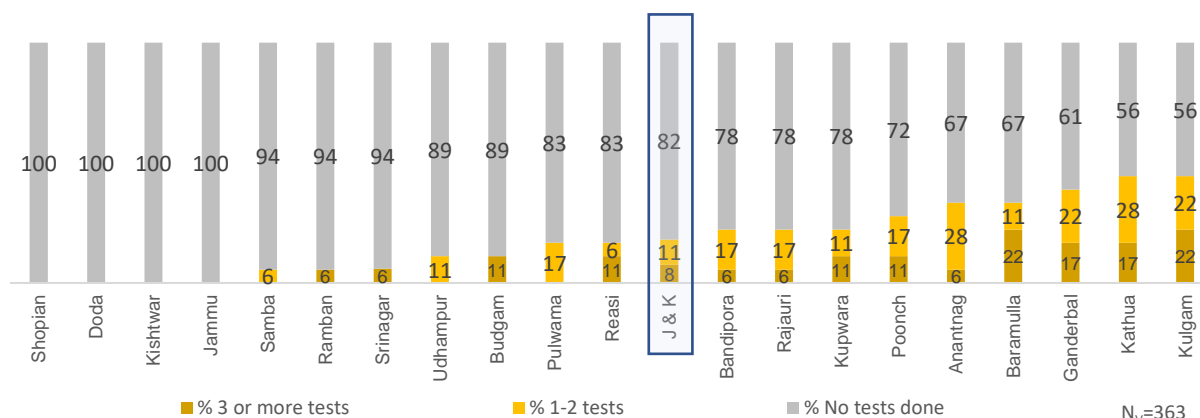Figure 42: Frequency of lab testing




Across the state, less than one-tenth of the total sampled villages (8%) reported that the quality of water (at different points in the respective villages) was checked at least three times through laboratories in last one year. Among the districts, Kulgam had the highest proportion of such villages, wherein 22% of its villages reported tests through laboratories - three or more times in last one year.

## E. Water quality management by VWSC: Bacteriological test done in last one year

With regards to water quality testing in the village by VWSC, **22% villages** in the state reported having bacteriological test done in the last one year.

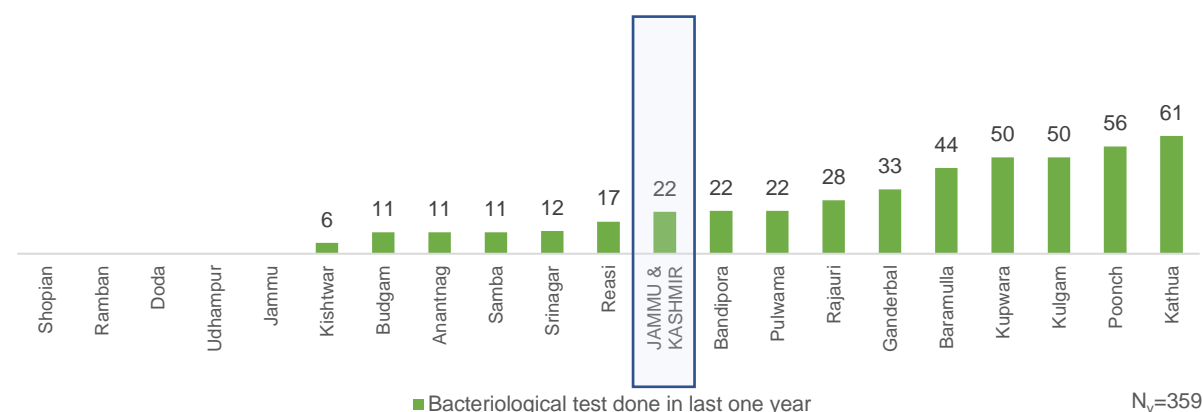
Figure 43: Percent villages in which Bacteriological test was done in the last one year



## F. Water quality management by VWSC: Bacteriological test done through laboratory testing in the last one year

Laboratory based bacteriological tests, in last one year, was reported by 17% of sampled villages. 50% of the sampled villages from the districts Kathua, and Poonch reported to have had bacteriological tests done through laboratories in last one year.

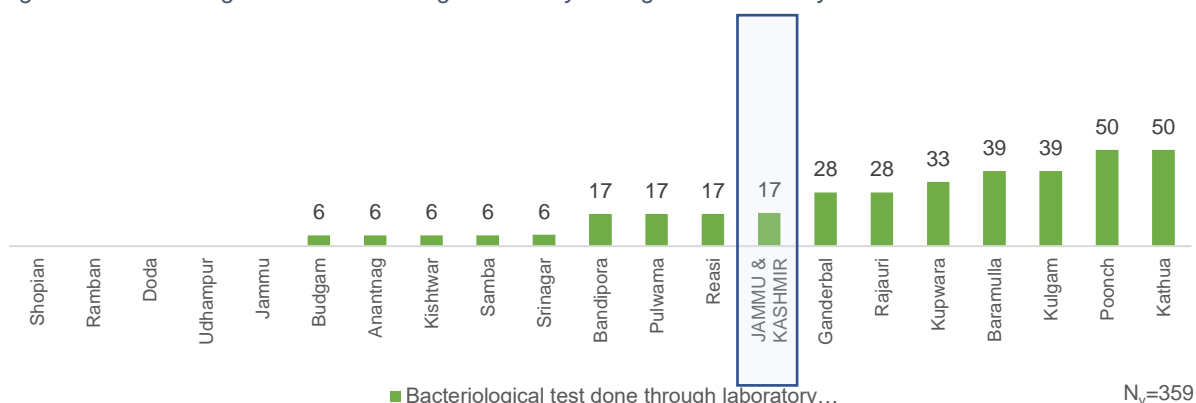
Figure 44: Bacteriological test done through laboratory testing in the last one year



## G. Water quality management by villages: Availability of chlorination mechanism in the village

More than **19% villages** reported that there is availability of chlorination mechanism in the village but during onsite testing of water at household level only 24% households tested to have for presence of chlorine.

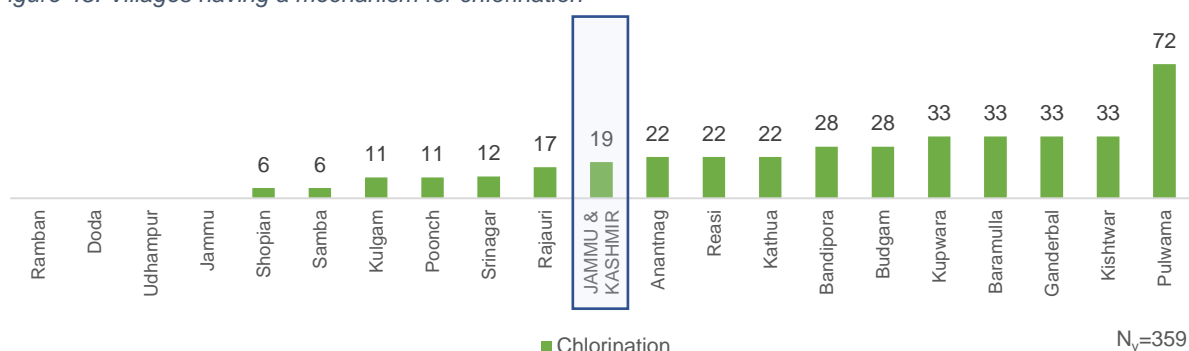Figure 45: Villages having a mechanism for chlorination




### 3.7. Management of water service delivery at village level

#### A. VWSC/Pani Samiti responsibility for O&M of PWS schemes

In the state, **4% villages** that have VWSC/Pani Samiti reported to be responsible for operation and maintenance of PWS. Srinagar, Pulwama, Shopian, Anantnag, Kulgam, Ramban, Doda, Kishtwar, Udhampur, Jammu, Samba and Kathua districts reported that VWSC/Pani Samiti are not responsible for operation and maintenance of PWS.

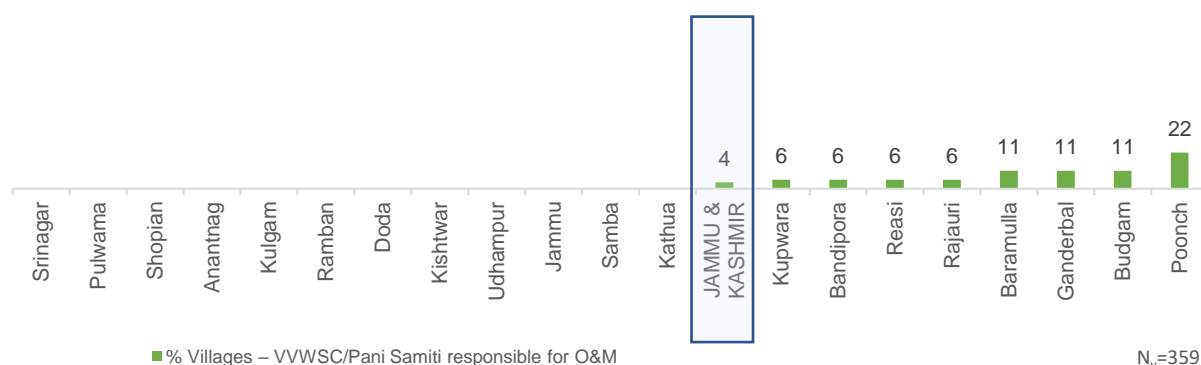
Figure 46: VWSC/Pani Samiti responsibility for O&M of PWS schemes



#### B. Villages levying water service delivery charges from households

Overall, **57% of villages** in the state levy charge for water service delivery to households whereas **70% HHs** reported paying water service delivery charges at the households.

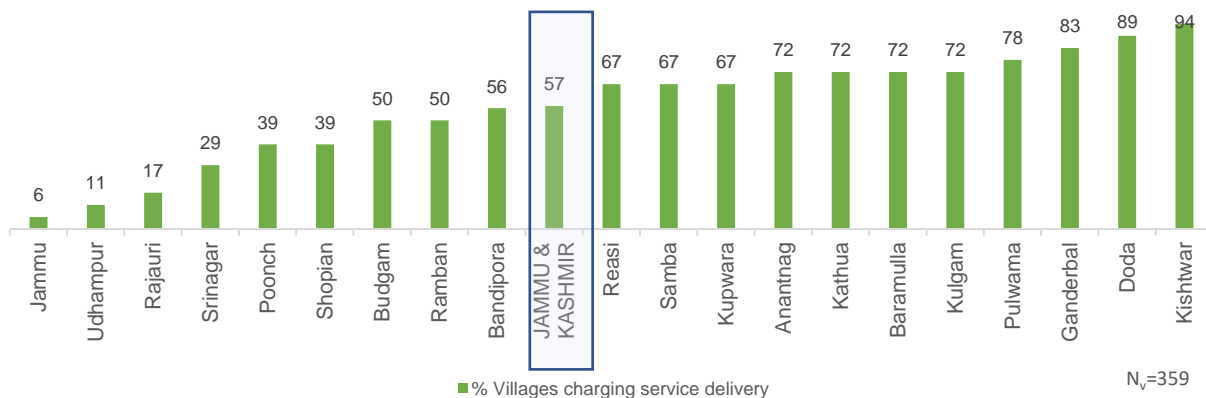Figure 47: Villages levying water service delivery charges from households






### C. Convergence of JJM activities with other schemes in villages

In the state, only **8% villages** in the state reported convergence of activities under JJM with other government programmes/ schemes on skill development, capacity building and training, and awareness generation.

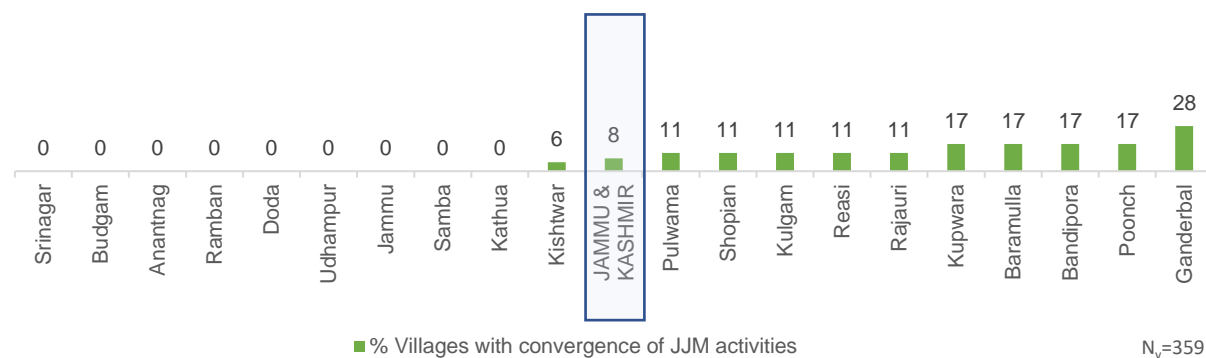
Figure 48: Village reported convergence of JJM activities with other schemes in the village



### D. Villages where signages

Signages about JJM were observed in 4% of the sampled villages. District Kulgam had the highest proportion of villages where signages were observed (22%).

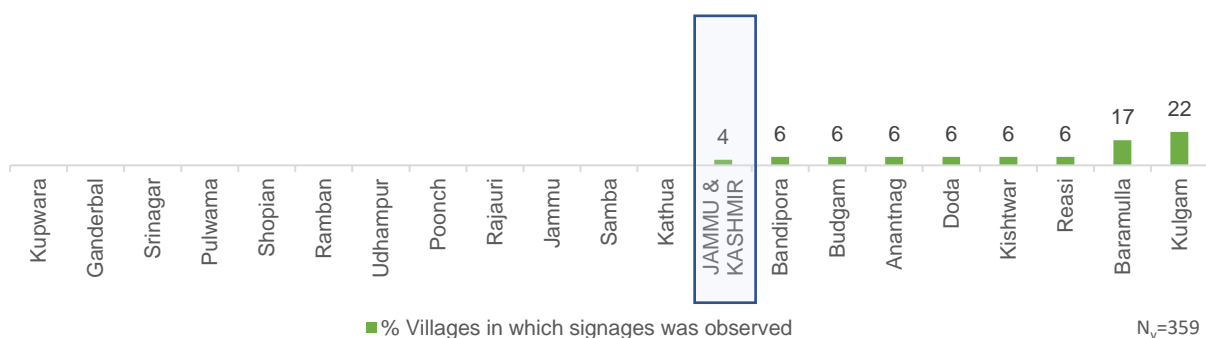Figure 49: Villages in which signages about JJM was observed




## 3.8. Status of Operation & Maintenance

### A. Villages with skilled manpower for operation and maintenance (O&M) of PWS schemes

Across the state, **17% villages** in the reported having identified skilled manpower for O&M of PWS schemes, the most reported to be in Reasi (56%) and the least in Jammu, Doda, Ramban, Anantnag, Pulwama, and Bandipora (0%)

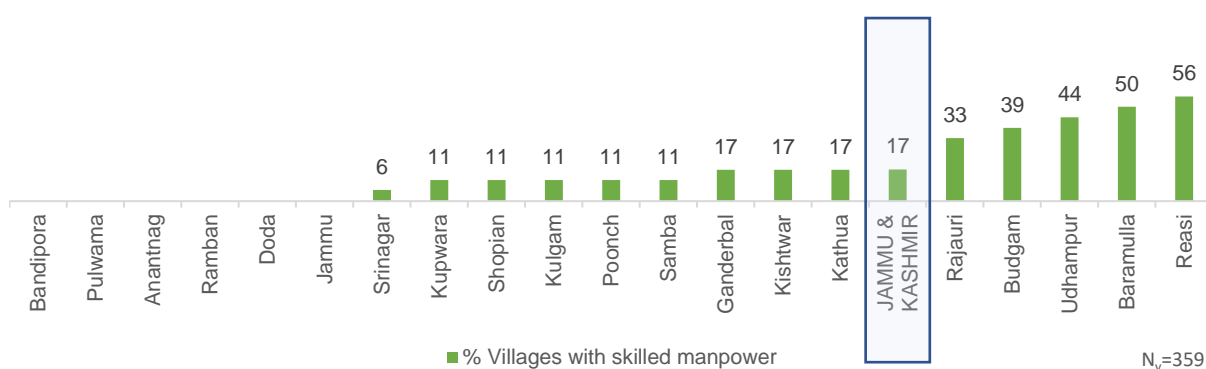
Figure 50: Villages reported having skilled manpower for O&M of PWS schemes



## B. Villages with O&M challenges

In the state, **18% of villages** in the state reported to have faced challenges with respect to O&M of PWS schemes

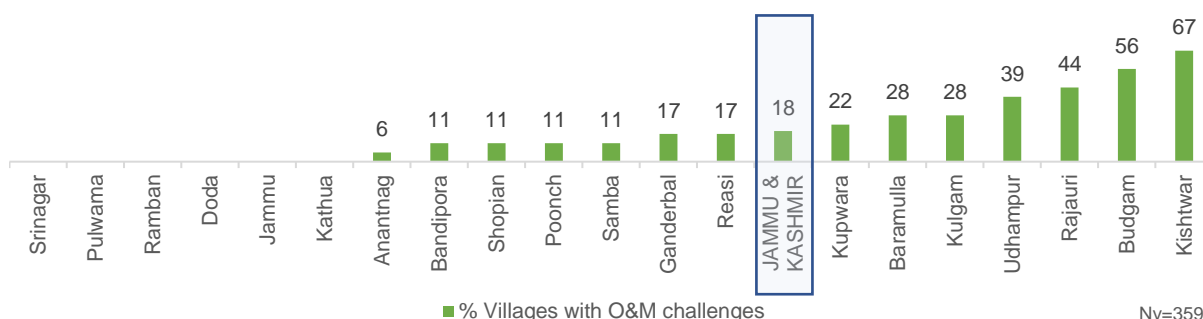
Figure 51: Villages reported having faced O&M challenge



## C. Details of challenges faced

Out of the 18% of villages that had faced challenges with respect to O&M of PWS schemes (66 villages), 'insufficient water pressure at tail-end/HH at elevation' was attributed the most – at 58%.

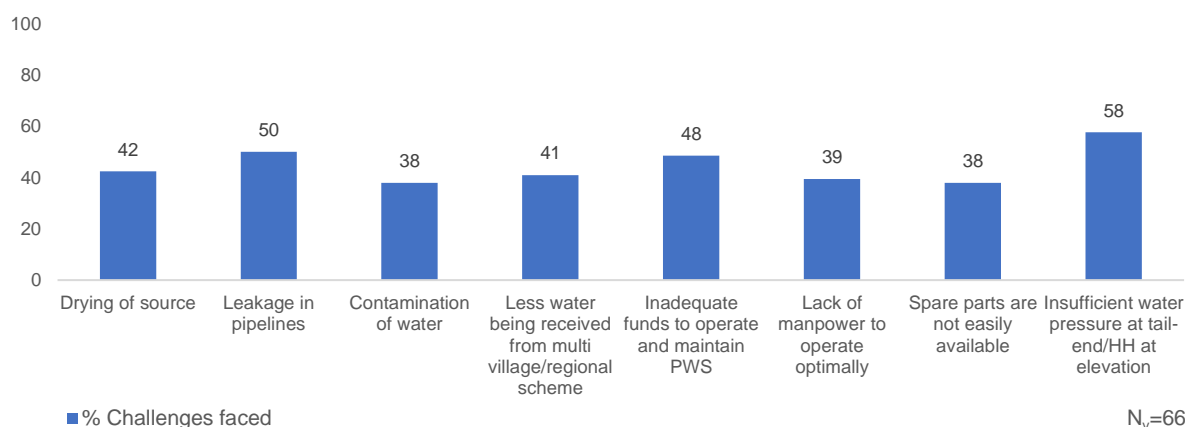
Figure 52: Details of O&M challenges faced by village



## D. Responsible for O&M

Across the state, villages reported 'PHED' the most for being responsible for all essential aspects about operation and maintenance of PWS schemes.

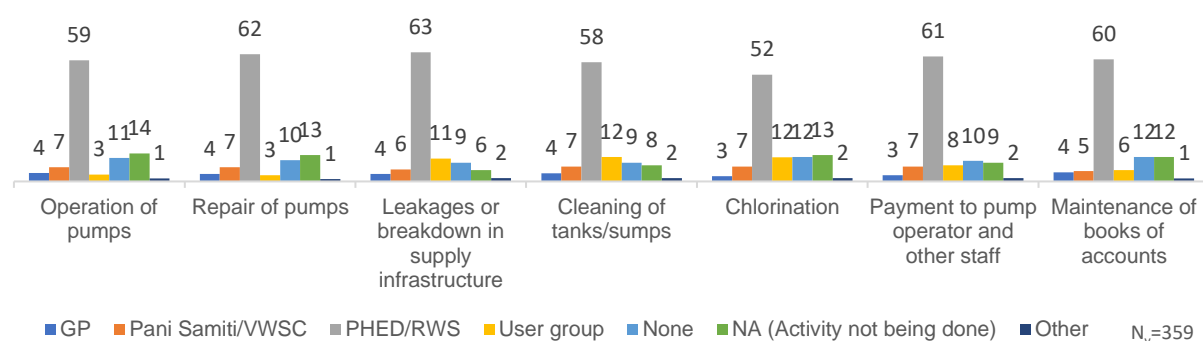
Figure 53: Responsibility of O&M in villages



### E. Villages with community level monitoring of water wastage

**7% of villages** in the state reported to have community level monitoring of water wastage

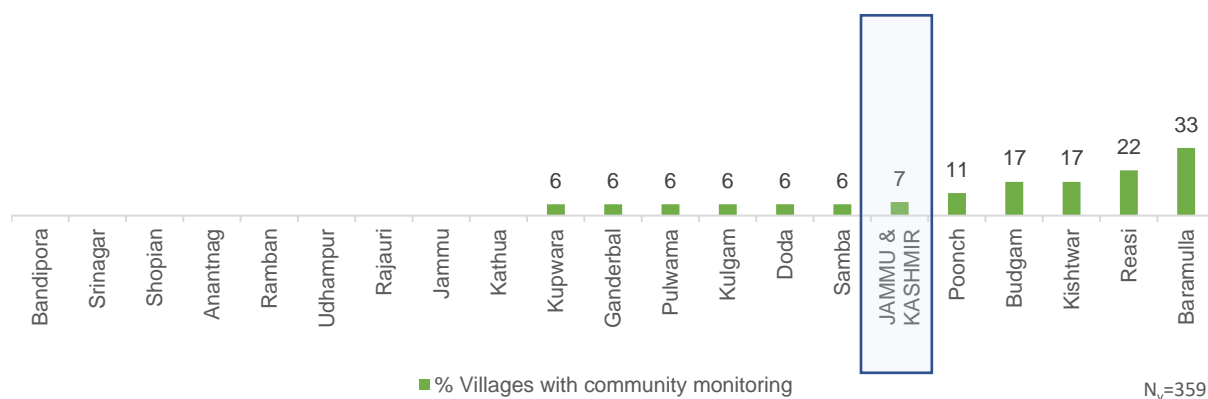Figure 54: Villages reported having community level monitoring of water wastage




### 3.9. Status of service delivery related grievances and redressal

#### A. Village level

##### Grievance redressal at village

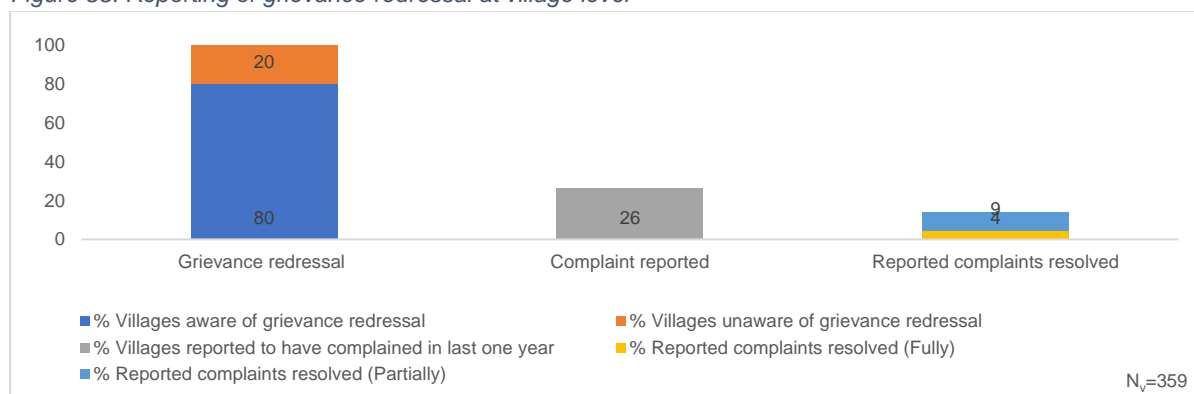Figure 55: Reporting of grievance redressal at village level




In the state, **80% of villages** reported that they are aware of any grievance redressal mechanism, but only 26% HHs have reported a complaint in the last one year amongst which 4% reported that the complaints are fully resolved while 9% of complaints have been partially resolved.

##### Problem reported in last 1 year

Among the villages who reported a complaint (i.e. 95 villages), 9% villages have reported a complaint more than 10 times in the last one year, while 32% reported a complaint at least once or twice.

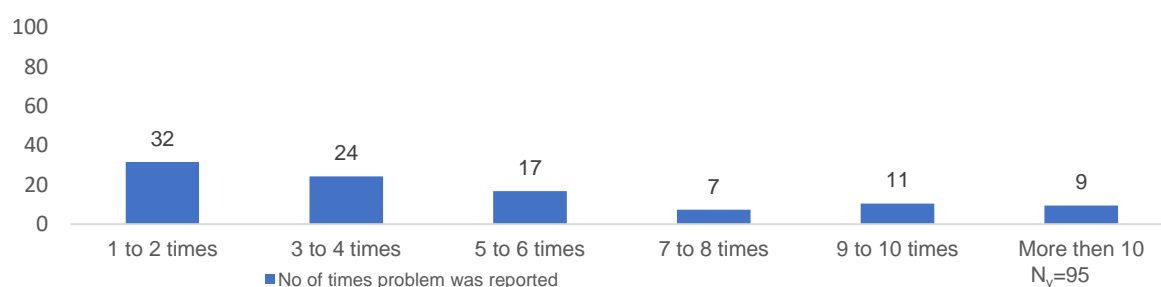
Figure 56: Number of times villages have reported grievance in last 1 year



## Primary points for reporting grievances

Among those who reported complaint (i.e., 26% HHs, 95 villages), **84% of villages** reported that they report their grievances to **PHED or other authorities** beside other reporting-points

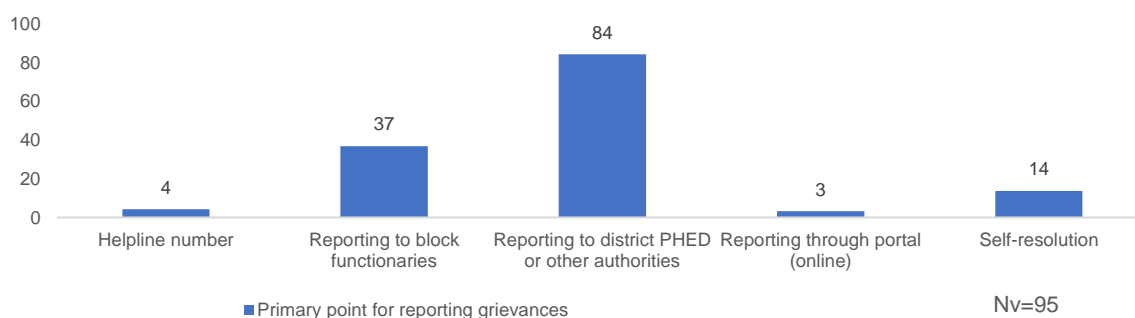
Figure 57: Primary points for reporting grievances by village



## Key problems for reporting grievances

Overall, among those who reported complaint (i.e., 26% HHs, 95 villages) **65% of villages** reported that **leakage in the pipeline** is their most encountered problem for reporting grievances

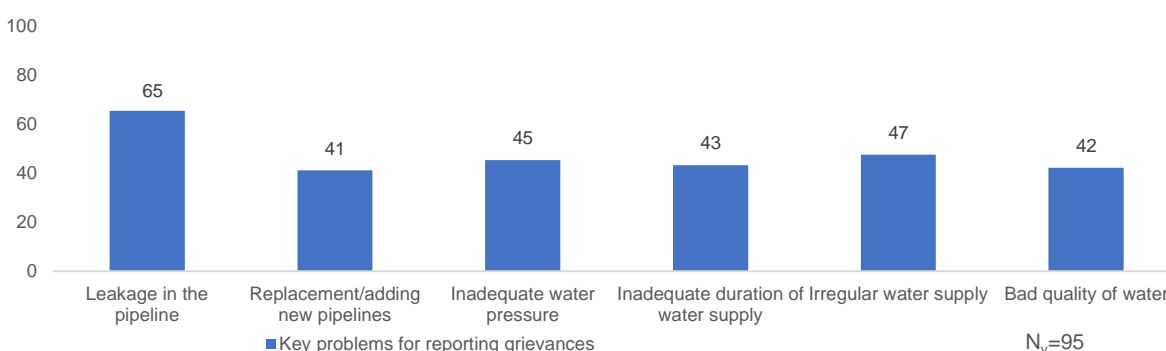Figure 58: Key problems reported by village




## B. Household level

### Awareness of grievance redressal at household

In the state, **90% of HHs** reported that they are aware of any grievance redressal mechanism w.r.t. HH tap water through PWS, but only 13% HHs have reported a complaint in the last one year and only 8% of complaints have been resolved.

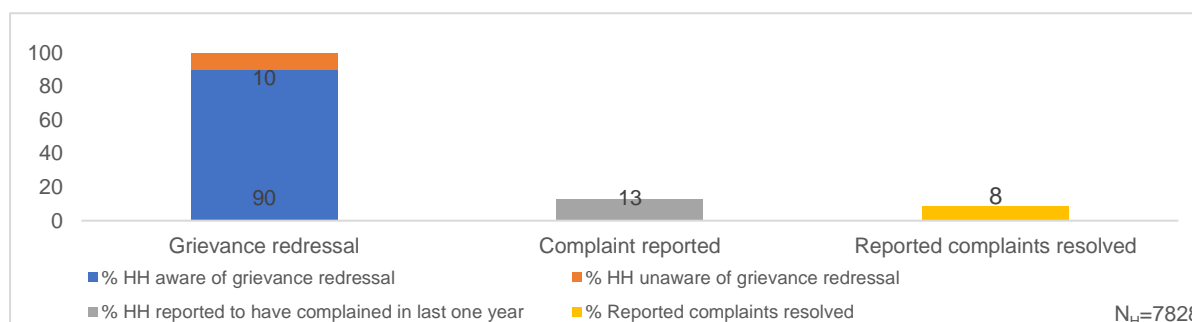
Figure 59: Reporting of grievance redressal at village level



### Primary channels for reporting grievances by households

Among those who reported complaint as shown in the above graph (i.e., 13% HHs, 1016 HHs), **75%** of the HHs reported their complaints to the **pump operators** beside other reporting-channels

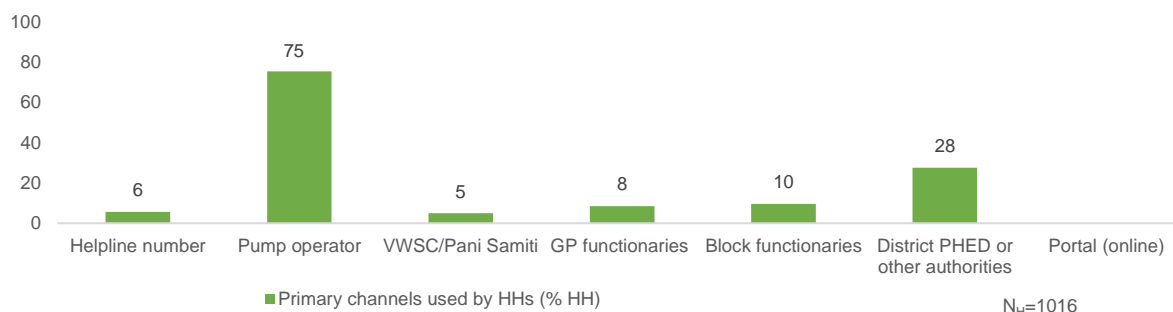
Figure 60: Primary channels for reporting grievances by households



### Key problems for reporting grievances

Overall, among those who reported complaint (i.e., 13% HHs, 1016 HHs) **54%** of the HHs that reported problems was of **leakage in the pipeline** beside other problems

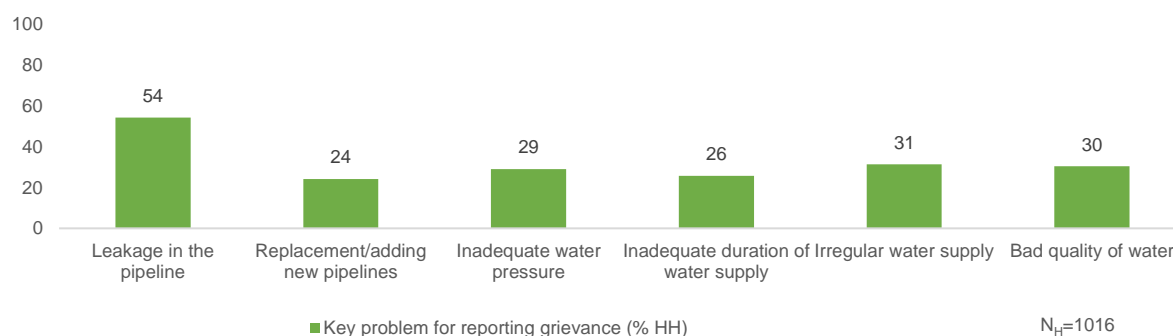Figure 61: Key problems reported by households




### 3.10. Perception of HHs on Outcome Indicators

#### A. Incidence of water borne diseases at HH level in last one year

Across the state only 2% HHs reported having an incidence(s) of water borne and 1% water related diseases in their household in last one year. The cases recorded were of Dysentery, Diarrhoea, Cholera and Typhoid

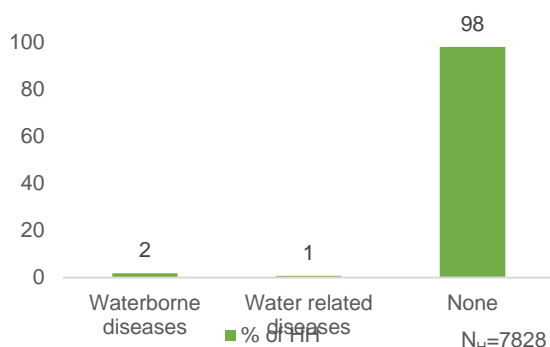
Figure 63: Household reported incidence of water borne diseases in last one year



#### B. Change in employment days since FHTC programmes/schemes

Since having a functional HH tap connection, 25% HHs across the state has reported that there has been a change in the no. of employment days of the adult HH members while 54% HHs reported no change

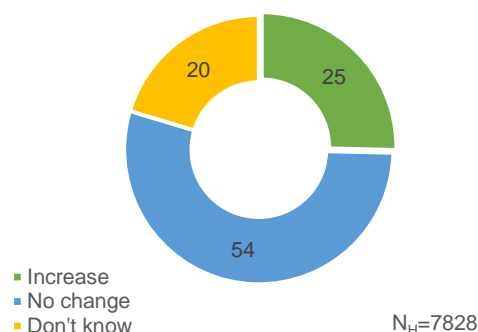
Figure 62: Household reported a change in employment days since FHTC programmes /schemes



#### C. Reduction in time and effort in collecting water

Out of the HHs reported (i.e. 5848) that female members used to fetch water before HH tap connection, 85% reported that post installation of HH tap connection it helped reduction of time and effort in collection of water

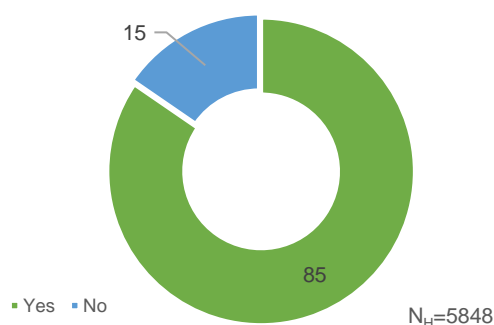
Figure 65: Households reported reduction in time and effort in collecting water



#### D. Impact on attendance of the girls going to upper primary

Across the state, 6% HHs reported that since having a functional HH tap connection the attendance of the girls going to schools increased, while 31% HHs reported no change in attendance which could possibly be an impact of shutting down of schools due to COVID-19 related lockdown during the survey

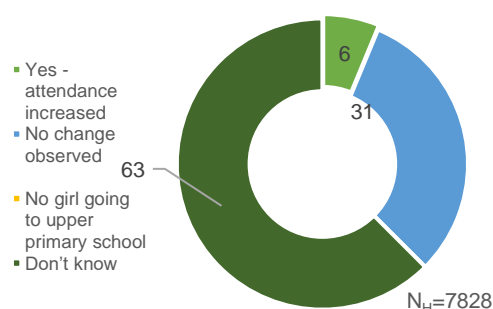Figure 64: Households reported increase of attendance of girls going to upper primary school





### E. Utilization of time saved by household's post installation of HH tap connection

Time saved by female HH members against collecting water, post installation of HH tap connections, was reportedly most utilized for spending time with family and children (68%).


Figure 66: Utilization of time saved by household's post installation of HH tap connection



### F. Change in social status

Sense of pride and positive change in social status was reportedly realized by 77% of HHs post the installation of HH tap connections.

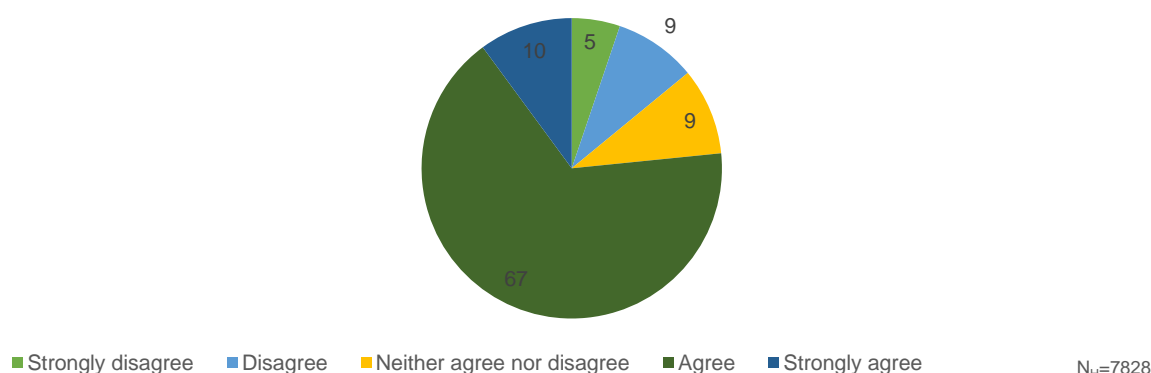
Figure 67: Households reported to have a positive change in social status








### G. Direct benefits in terms of income due to FHTC

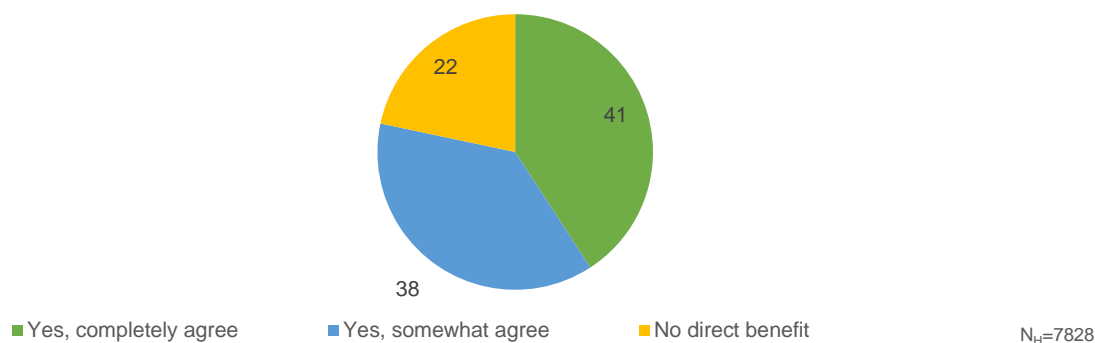Across the state, 41% of sampled HHs reported being in complete agreement that there had been direct benefits on their HH income since the installation of HH tap connection, while 38% HHs reported being in partial agreement against the same.

Figure 68: Households reported to have received direct benefits in terms of income due to FHTC



### 3.11. User satisfaction

Table No. 7: User satisfaction - more than 75% happy with FHTC services			
S. No.	Parameter (N <sub>h</sub> =7780)		In %
1	Regularity		80.4
2	Overall quality		82.5
3	Colour		84.3
4	Taste		84.4
5	Odour		84.3

**Note:**

Base (N<sub>v</sub>)=359 means all villages sampled and covered in Jammu and Kashmir state

Base (N<sub>H</sub>)=7828 means all households sampled and covered across the 359 villages in Jammu and Kashmir state

Base (N<sub>H</sub>)=7580 means all households sampled where water sample be collected across the 359 villages in Jammu and Kashmir state


Base (N<sub>H</sub>)=5848 means all households sampled where female members used to fetch water before HH tap connection

Base (N<sub>H</sub>)=7828 means all households sampled that had adolescent girls as one of HH members

## 4. Functionality status of FHTC at household level for Har Ghar Jal districts

### 4.1. Overall Functionality (in %)

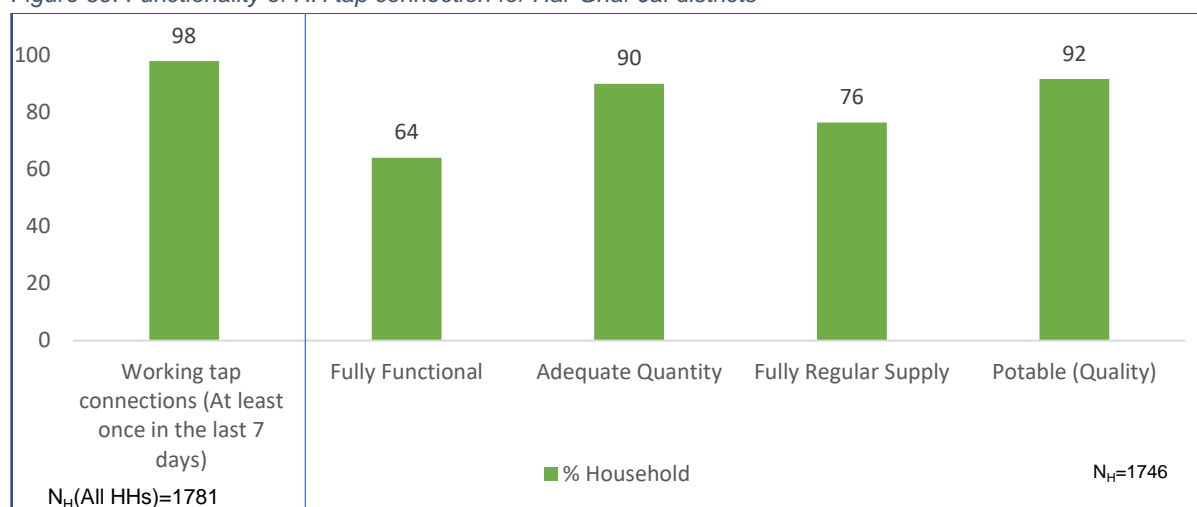Figure 69: Functionality of HH tap connection for Har Ghar Jal districts



\* Fully Functional has been computed as = Adequate Quantity  $\cap$  Fully Regular Supply  $\cap$  Potable (Quality)

Please note: For Har Ghar Jal district, N<sub>H</sub>=1746 implies all HHs where water was found on the day of the survey.

It has been found that 98 percent of the sampled HHs (N=1781) had working tap connections. 64 percent HHs in the state were found to have fully functional HH tap water connection. Moreover, 9 out of 10 households (90 percent) received adequate quantity ( $\geq 55$  LPCD) of water supply and more than three-fourth received regular supply (76 percent) of water. The on-site testing and lab test results of the water indicates that more than 9 out of 10 (92%) sampled households in the state receive potable water.

Table No. 8: Quantity, Regularity, and Quality of FHTC for aspirational districts (%HH)						
S. No.	District	Working tap connections (HHs which received water through FHTC at least once in the last 7 days) (% HH)	Fully functional (% HH)	Adequate Quantity (% HH)	Full Regular Supply (% HH)	Potable (Quality) (% HH)
1.	Reasi	72	100	100	85	93
2.	JAMMU & KASHMIR	98	64	90	76	92
3.	Srinagar	98	65	100	90	91
4.	Kupwara	100	81	100	100	100
5.	Baramulla	100	51	84	87	46
6.	Ganderbal	100	69	81	82	98
7.	Budgam	100	48	97	53	92
8.	Pulwama	100	36	90	95	79
9.	Shopian	100	50	72	48	100
10.	Anantnag	100	42	98	42	89
11.	Kulgam	100	38	85	70	85
12.	Doda	100	78	97	42	100
13.	Kishtwar	100	100	96	40	98
14.	Poonch	100	67	100	100	100
15.	Rajauri	100	91	67	100	100
16.	Jammu	100	44	92	100	99

<b>Table No. 8: Quantity, Regularity, and Quality of FHTC for aspirational districts (%HH)</b>						
<b>S. No.</b>	<b>District</b>	<b>Working tap connections (HHs which received water through FHTC at least once in the last 7 days) (% HH)</b>	<b>Fully functional (% HH)</b>	<b>Adequate Quantity (% HH)</b>	<b>Full Regular Supply (% HH)</b>	<b>Potable (Quality) (% HH)</b>
17.	Samba	100	64	86	56	93


# Potable water has been considered basis testing of water samples through laboratory tests for physical, chemical, and bacteriological as given in Table 5 parameters (within acceptable/ permissible range) and onsite testing of pH. The details of laboratory test are mentioned in the table given above in the glossary.

## 4.2. Perception of HHs from Har Ghar Jal districts on Outcome Indicators

### A. Change in employment days since FHTC programmes/ schemes

Only around 21 percent of the households in Har Ghar Jal districts reported increase in employment days since installation of FHTC.

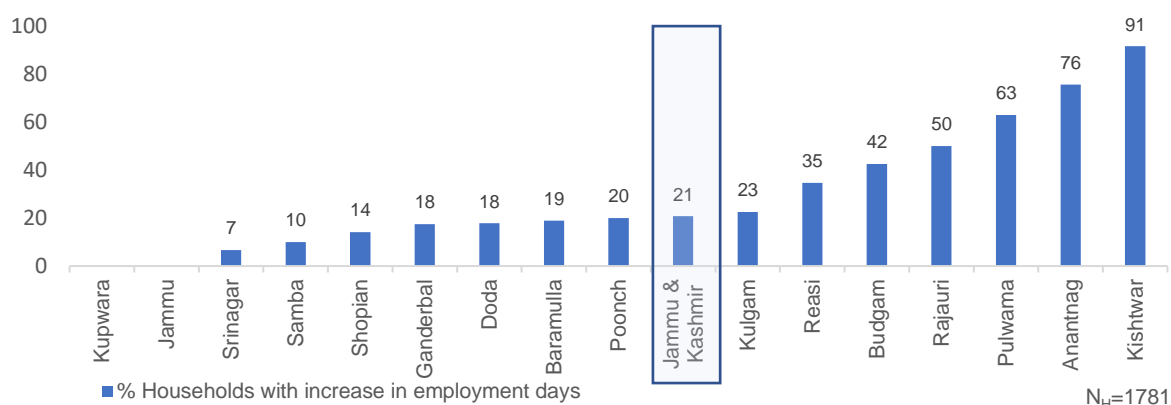
Figure 70: Household reported a change in employment days since FHTC programmes /schemes in Aspirational districts



### B. Reduction in time and effort in collecting water

93 percent of the households in Har Ghar Jal districts reported reduction in time and effort in collecting water.

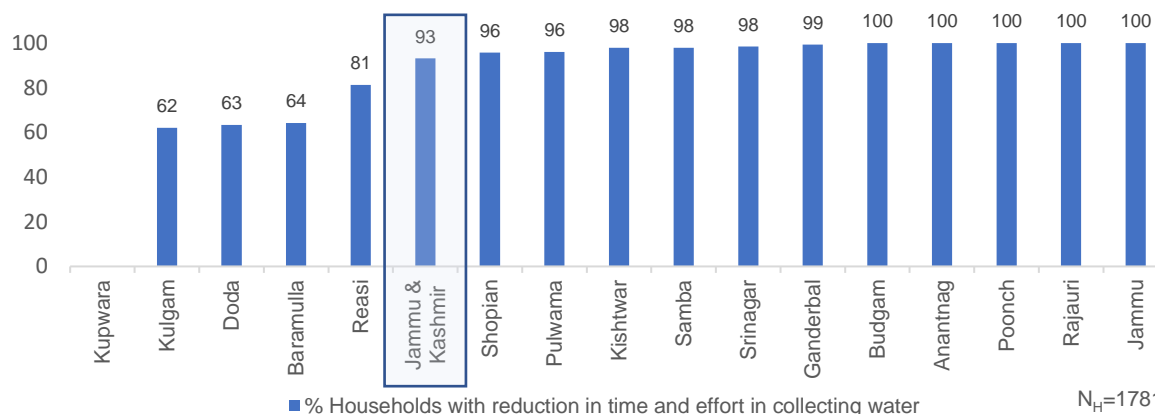
Figure 71: Households reported reduction in time and effort in collecting water in Har Ghar Jal districts



### 4.3. Direct benefits in terms of income due to FHTC

Across the state, 38% of sampled HHs from Har Ghar Jal districts reported being in complete agreement that there had been direct benefits on their HH income since the installation of HH tap connection, while 38% reported being in partial agreement against the same.

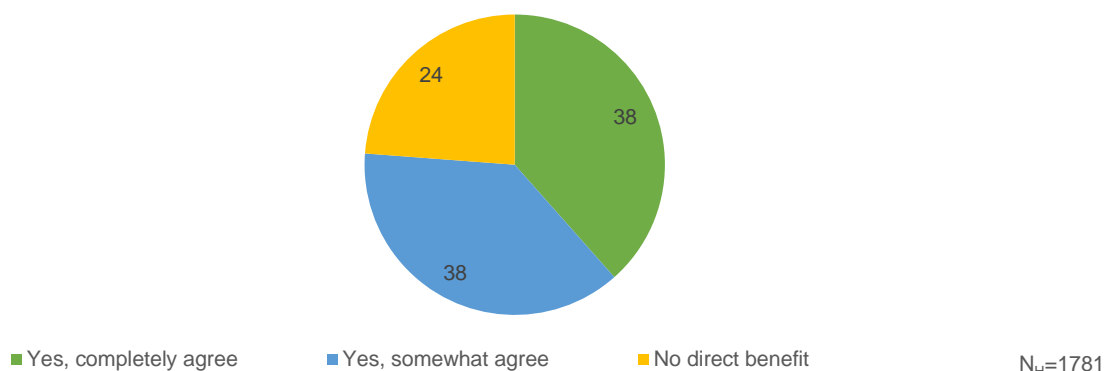
Figure 72: Households reported to have received direct benefits in terms of income due to FHTC in Aspirational districts



### 4.4. Change in social status

More than three-fourth of the households in Har Ghar Jal districts felt HH tap connection earned them more respect, feeling of pride and brought a positive change in their social status.

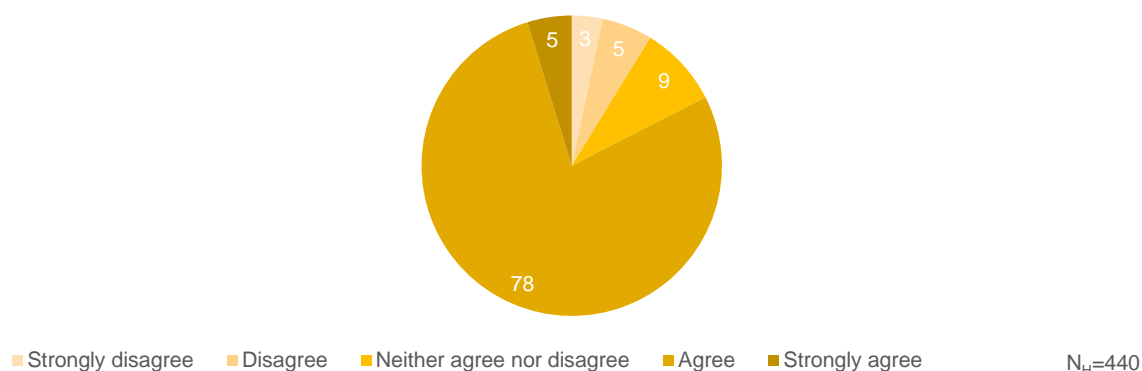
Figure 73: Households reported to have a positive change in social status in Aspirational districts



## 5. Functionality status of FHTC at household level for aspirational districts

### 5.1. Overall Functionality (in %)

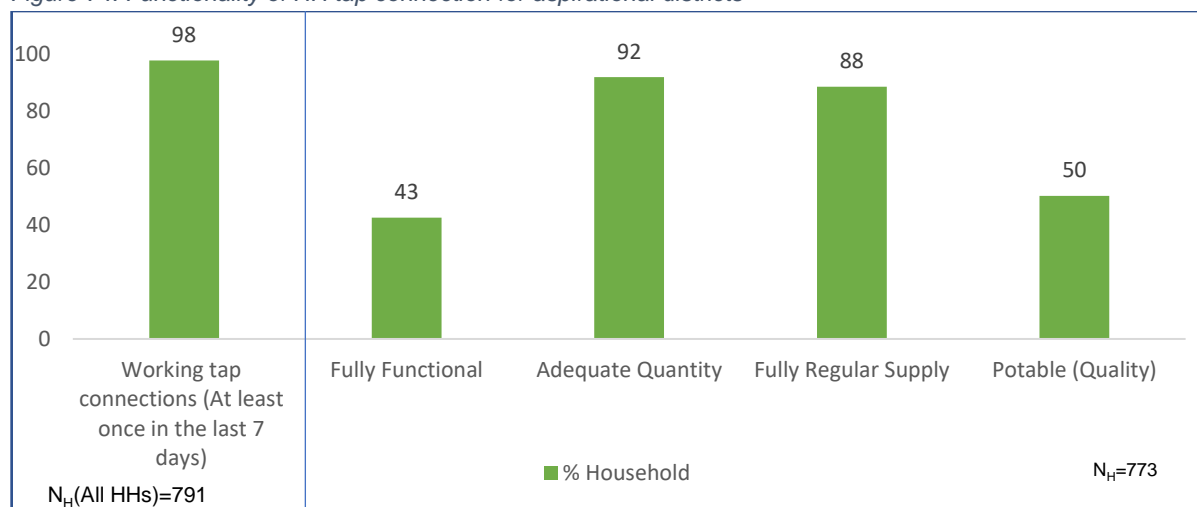Figure 74: Functionality of HH tap connection for aspirational districts



\* Fully Functional has been computed as = Adequate Quantity  $\cap$  Fully Regular Supply  $\cap$  Potable (Quality)

Please note: For aspirational district, N<sub>H</sub>=773 implies all HHs where water was found on the day of the survey.

It has been found that 98 percent of the sampled HHs (N=791) had working tap connections. 43 percent HHs in the state were found to have fully functional HH tap water connection. Moreover, more than 9 out of 10 households (92 percent) received adequate quantity ( $\geq 55$  LPCD) of water supply and more than 4 out of 5 received regular supply (88 percent) of water. The on-site testing and lab test results of the water indicates that half (95%) of the sampled households in the state receive potable water.

Table No. 9: Quantity, Regularity, and Quality of FHTC for aspirational districts (%HH)						
S. No.	District	Working tap connections (HHs which received water through FHTC at least once in the last 7 days) (% HH)	Fully functional (% HH)	Adequate Quantity (% HH)	Full Regular Supply (% HH)	Potable (Quality) (% HH)
1	Baramulla	95	23	92	90	25
2	JAMMU AND KASHMIR	98	43	92	88	50
3	Kupwara	100	60	92	87	73


# Potable water has been considered basis testing of water samples through laboratory tests for physical, chemical, and bacteriological as given in Table 5 parameters (within acceptable/ permissible range) and onsite testing of pH. The details of laboratory test are mentioned in the table given above in the glossary.

## 5.2. Perception of HHs from aspirational districts on Outcome Indicators

### A. Change in employment days since FHTC programmes/ schemes

Only around 13 percent of the households in aspirational districts reported increase in employment days since installation of FHTC.

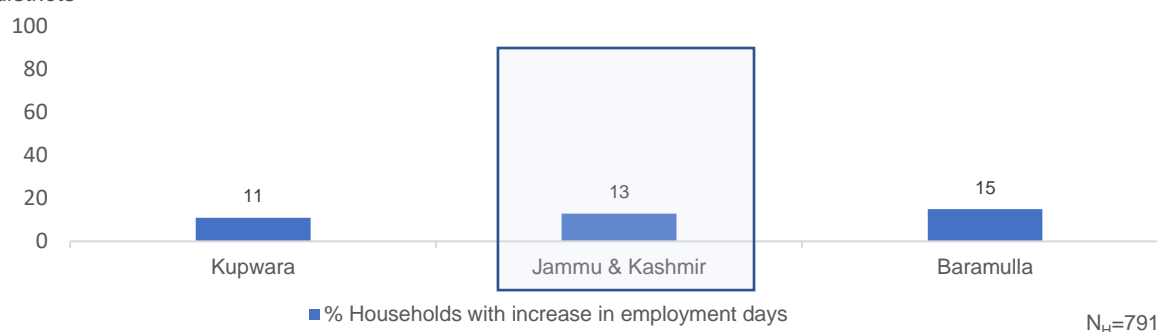
Figure 75: Household reported a change in employment days since FHTC programmes /schemes in Aspirational districts



### B. Reduction in time and effort in collecting water

88 percent of the households in aspirational districts reported reduction in time and effort in collecting water.

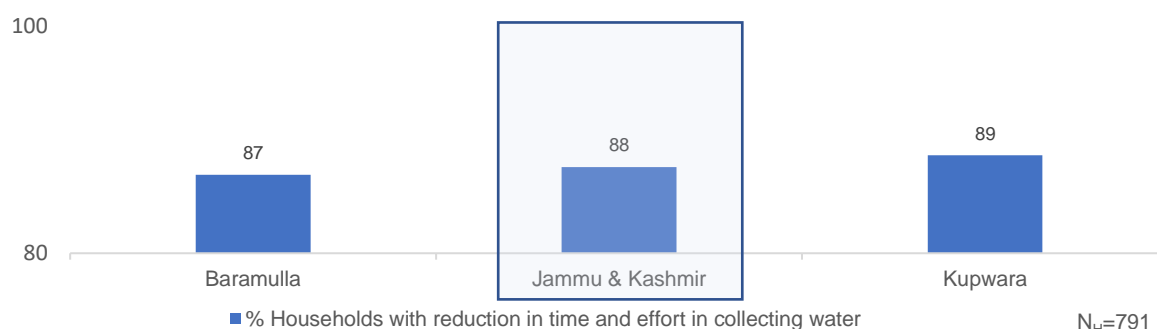
Figure 76: Households reported reduction in time and effort in collecting water in Aspirational districts



## 5.3. Direct benefits in terms of income due to FHTC

Across the state, 91% of sampled HHs from aspirational districts reported being in complete agreement that there had been direct benefits on their HH income since the installation of HH tap connection, while 9% reported being in partial agreement against the same.

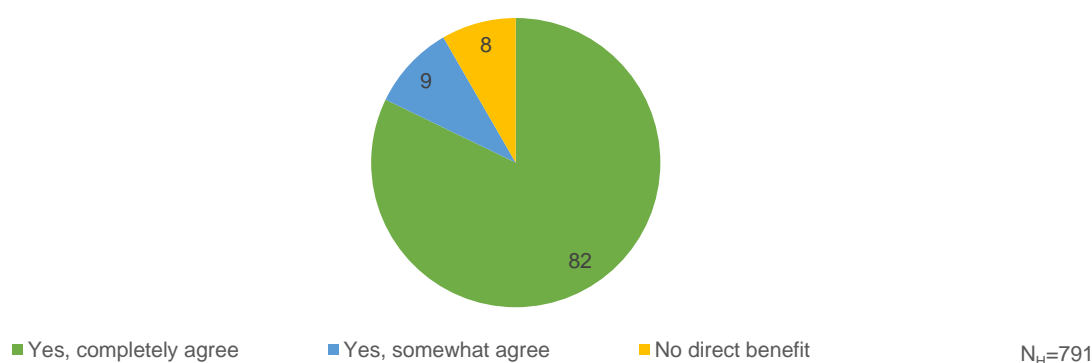Figure 77: Households reported to have received direct benefits in terms of income due to FHTC in Aspirational districts






## 5.4. Change in social status

More than three-fourth of the households in aspirational districts felt HH tap connection earned them more respect, feeling of pride and brought a positive change in their social status.

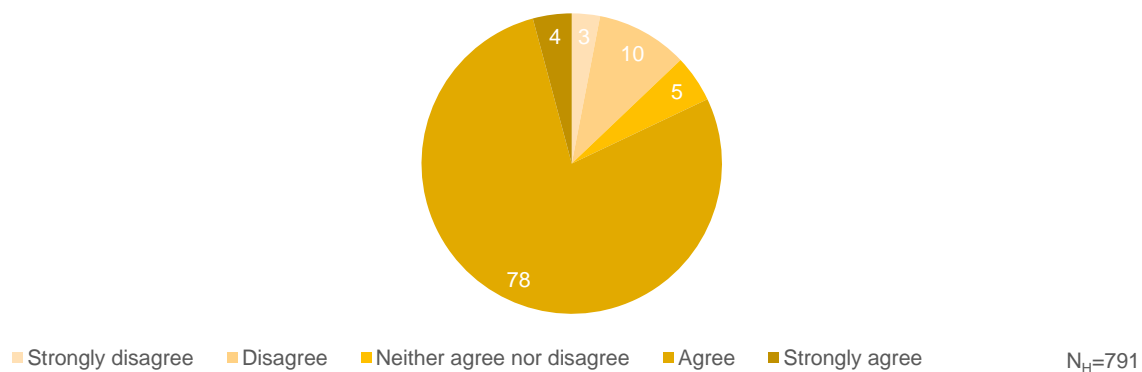Figure 78: Households reported to have a positive change in social status in Aspirational district.



## 6. Annexure

No sampled village replacement was made in the state.